







**Lockport-Batavia Line #112
Rebuild Project**

Appendix A

Plan & Profile Drawings





Part 3 of 11

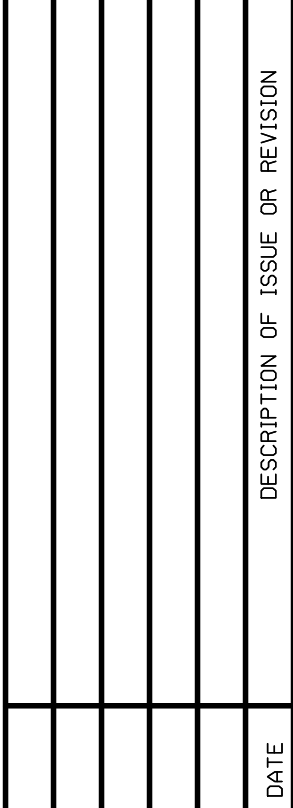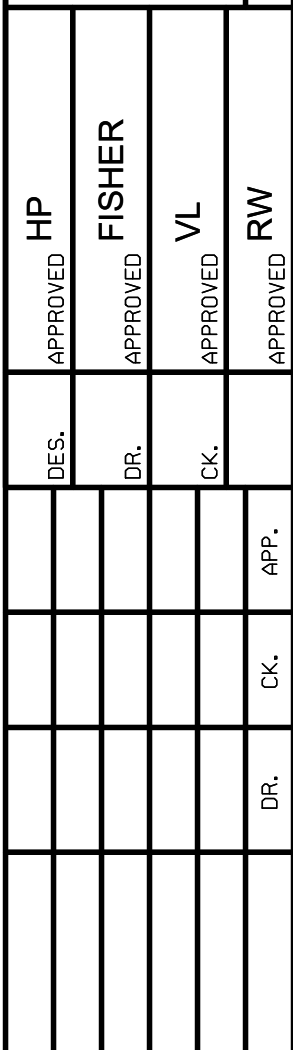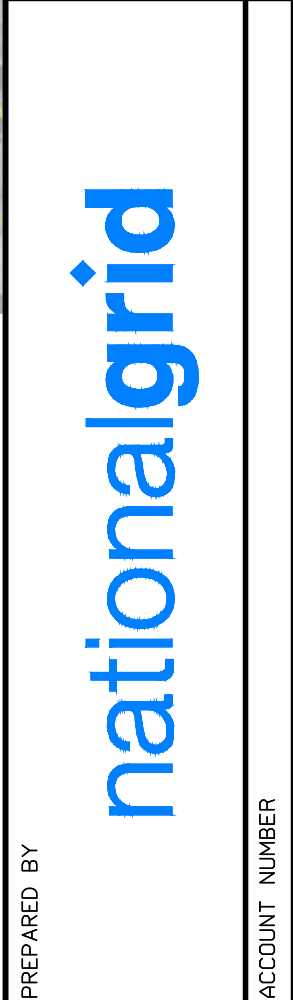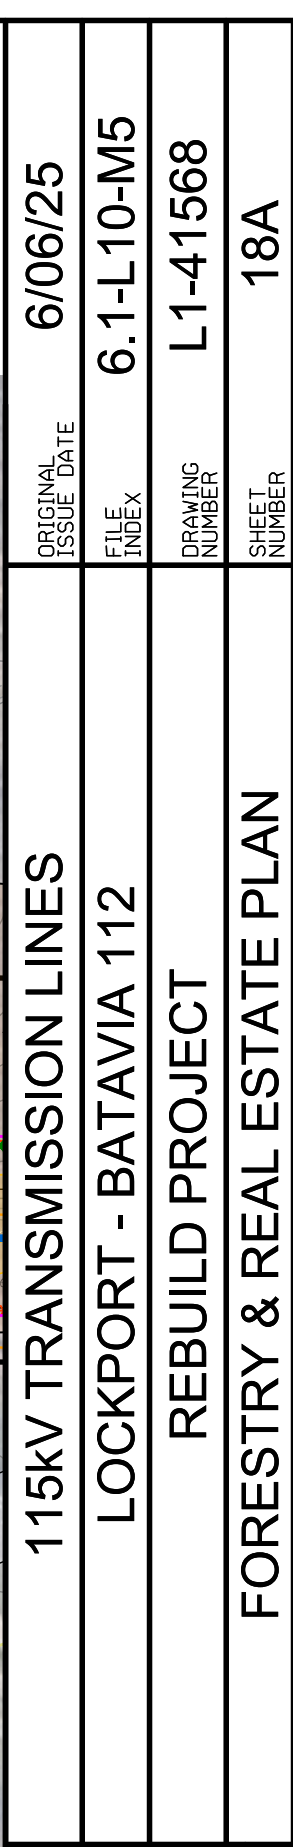

national|arid

PREPARED BY

6

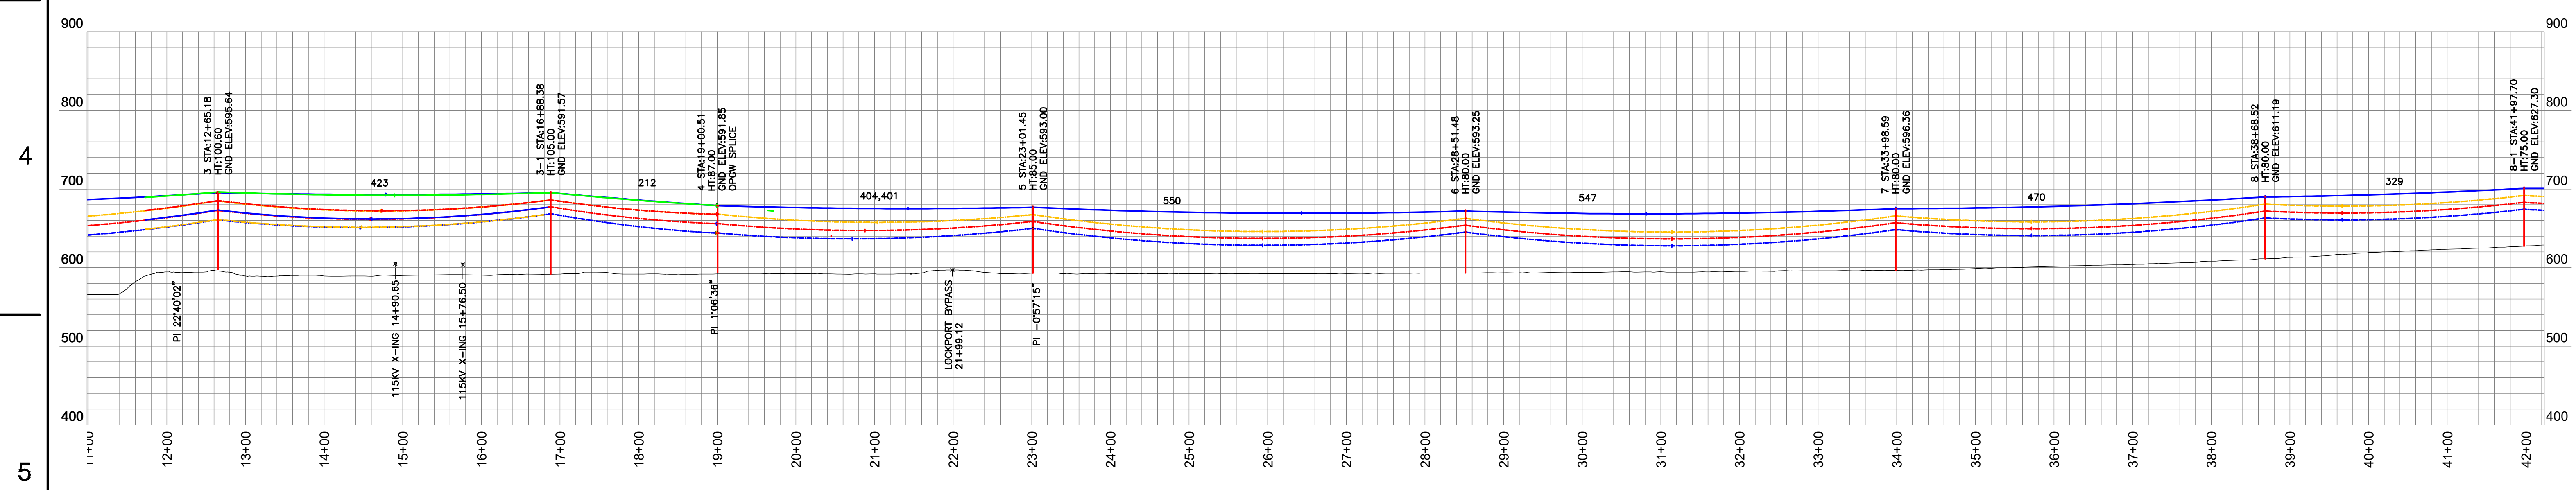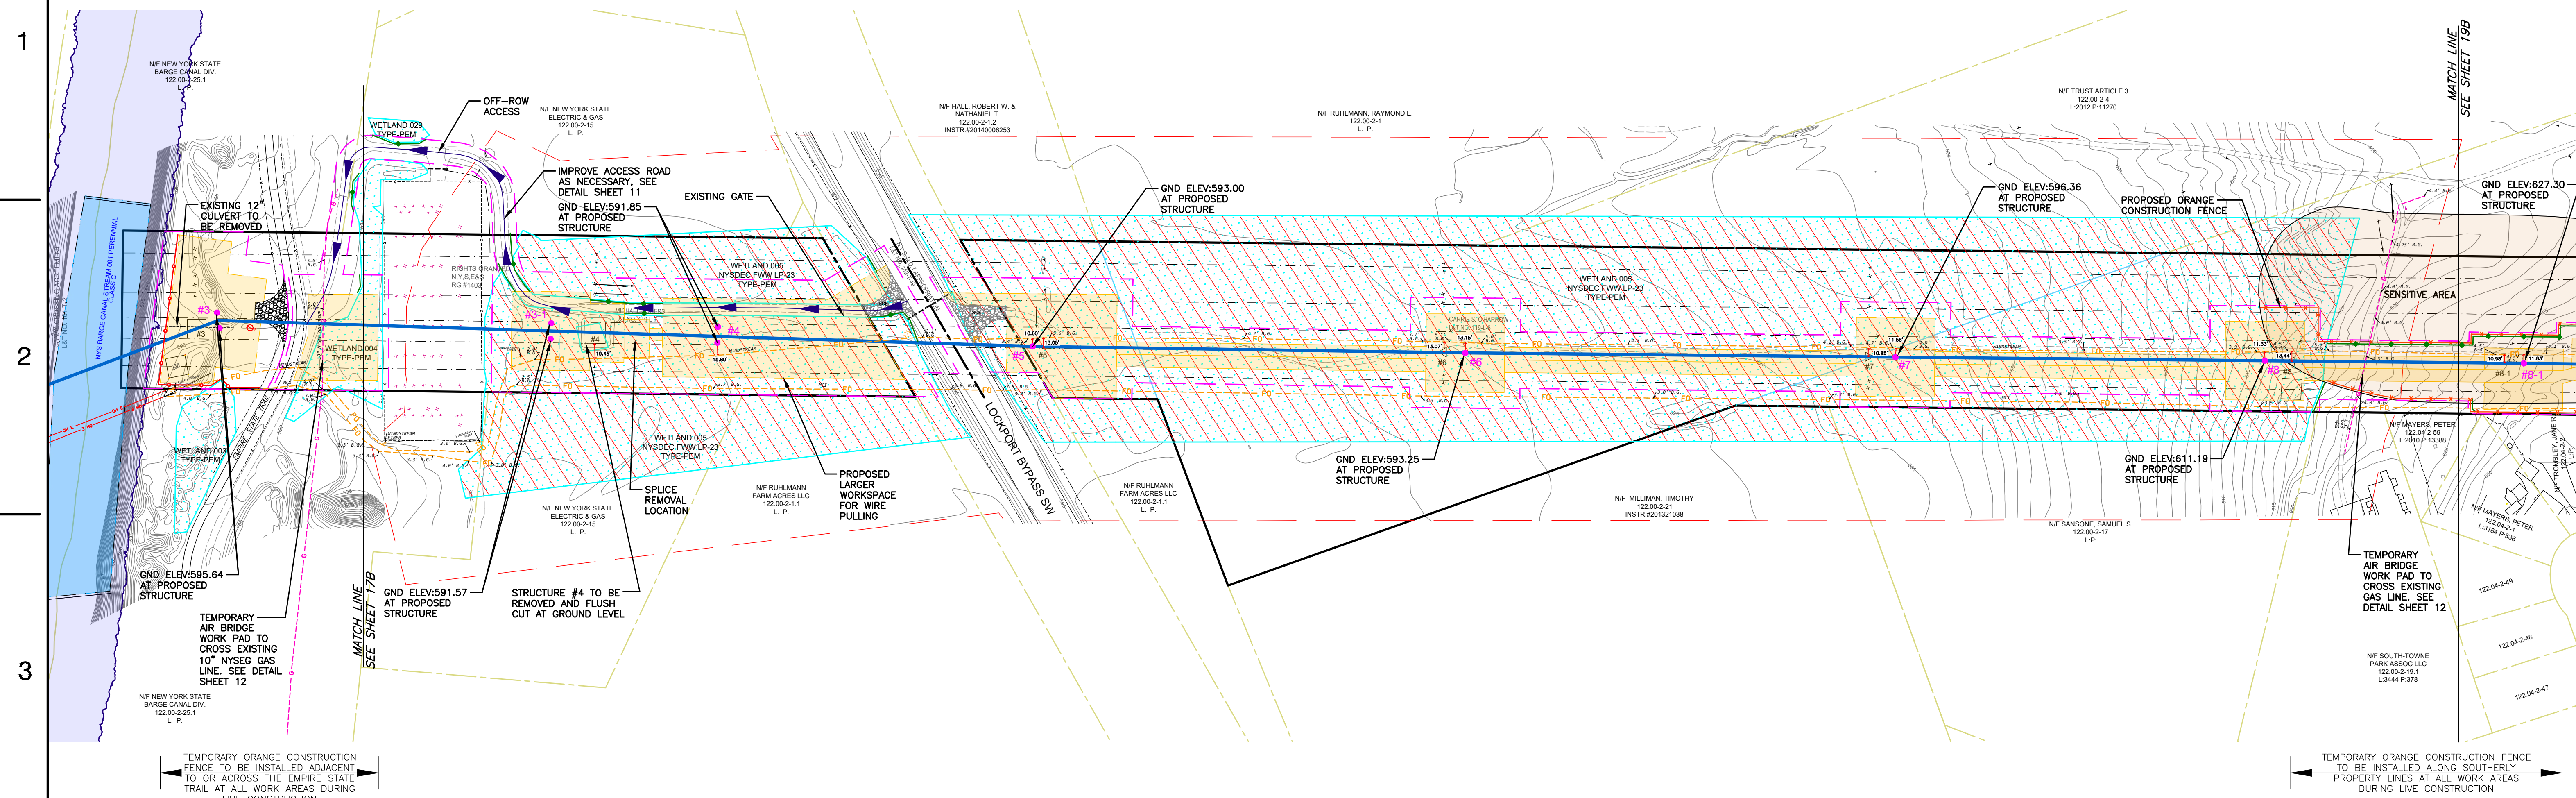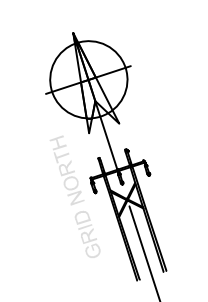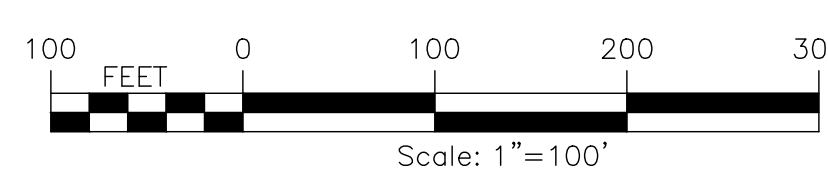

LOCKPORT - BATAVIA 112 LINE (FROM 1- 5 TO 211)																			
EXISTING STR NUMBER	NEW STR NUMBER	EXISTING STRUCTURE								TYPE	POLE 1			POLE 2		POLE 3		FOUNDATION TYPE	NOTES
		TYPE	POLE 1		POLE 2		POLE 3		MATERIAL		HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL			
			HT (FT, AGL)	CL	HT (FT, AGL)	CL	HT (FT, AGL)	CL											
3	3	DC STEEL LATTICE TOWER DE	79						SPDE	STEEL	105/0	N/A					INSTALL CONCRETE CAISSON (1)		
3A									SPDE	STEEL	105/0	N/A					INSTALL CONCRETE CAISSON (1)		
-	3-1	NO EXISTING STRUCTURE							BPSU-DELTA	STEEL	125/20	H4					INSTALL DIRECT EMBED (1)		
									BPSU-DELTA	STEEL	125/20	H4					INSTALL DIRECT EMBED (1)		
4									SPDE	STEEL	85/0	N/A					INSTALL CONCRETE CAISSON (1)		
4A	4	DC STEEL LATTICE TOWER DE	84						SPDE	STEEL	85/0	N/A					INSTALL CONCRETE CAISSON (1)		
5	5	SC WD MONOPOLE DA SUSP	75	UNK					BPSU-DELTA	STEEL	105/20	H4					INSTALL DIRECT EMBED (1)		
6	6	SC STL TRI LEGGED TOWER SUSP	57						BPSU-DELTA	STEEL	100/20	H3					INSTALL DIRECT EMBED (1)		
7	7	SC STL TRI LEGGED TOWER SUSP	57						BPSU-DELTA	STEEL	100/20	H3					INSTALL DIRECT EMBED (1)		
8	8	SC STL TRI LEGGED TOWER SUSP	57						BPSU-DELTA	STEEL	100/20	H3					INSTALL DIRECT EMBED (1)		
8-1	8-1	SC WD MONOPOLE DA SUSP	52	UNK					BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)		

LOCKPORT - BATAVIA LINE 112			
OPGW 1/2"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
3	4	363.73	5000
4	15	485.47	5000

LOCKPORT - BATAVIA LINE 112			
795 KCMIL ACSR "DRAKE"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
3	4	363.30	8000
4	15	485.46	8000




LINE 111			
795 KCMIL ACSR "DRAKE"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
2	3	487.11	8000
3	4	366.59	8000

LINE 111			
3/8 HS			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
3	4	367.11	3500





CONDUCTOR DISPLAYED AT 257° F
SHIELDWIRE DISPLAYED AT 120° F

PREPARED FOR CONSTRUCTION GROUP USE

HOWEVER, THIS SHEET SHOULD NOT BE CONSIDERED
THE SOLE SOURCE OF INFORMATION REQUIRED FOR THE
CONSTRUCTION OF THAT PORTION OF THE PROJECT
DEPICTED ON THIS SHEET AND SHOULD ONLY BE USED IN
CONJUNCTION WITH SHEETS OF THE SAME NUMBER
CONTAINED IN THIS SET OF PLANS.

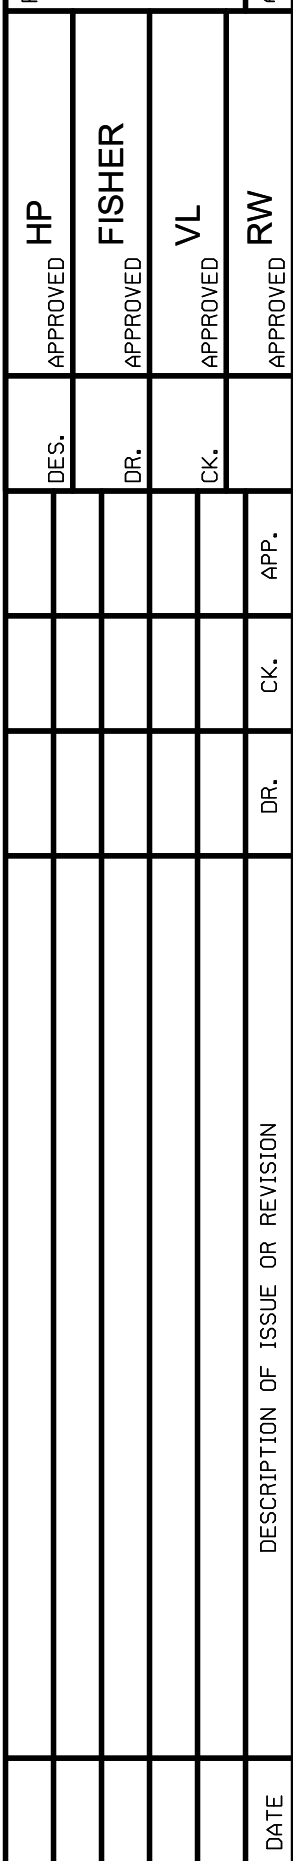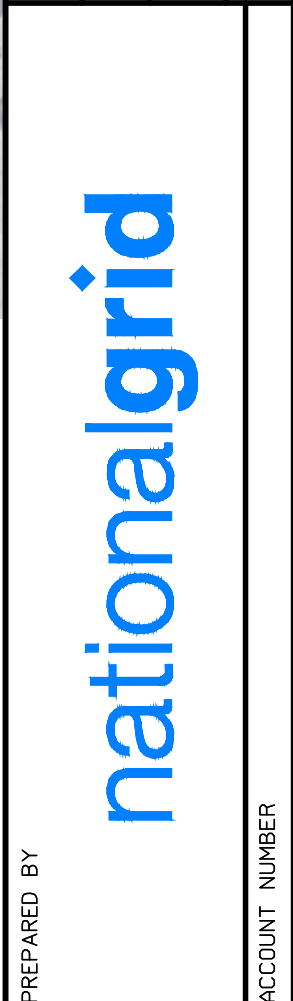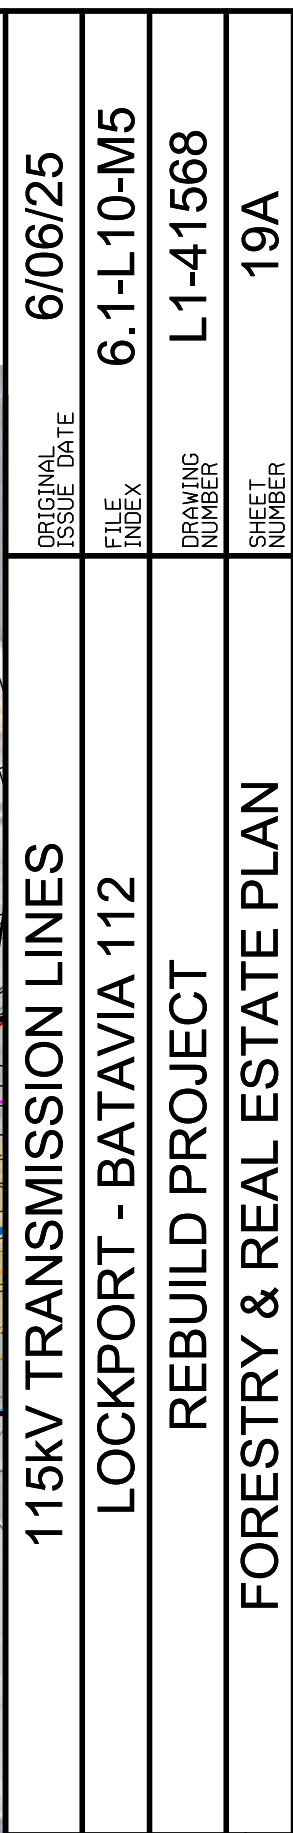

TOWN OF LOCKPORT T.D. 5119 - NIAGARA COUNTY
PLAN VIEW

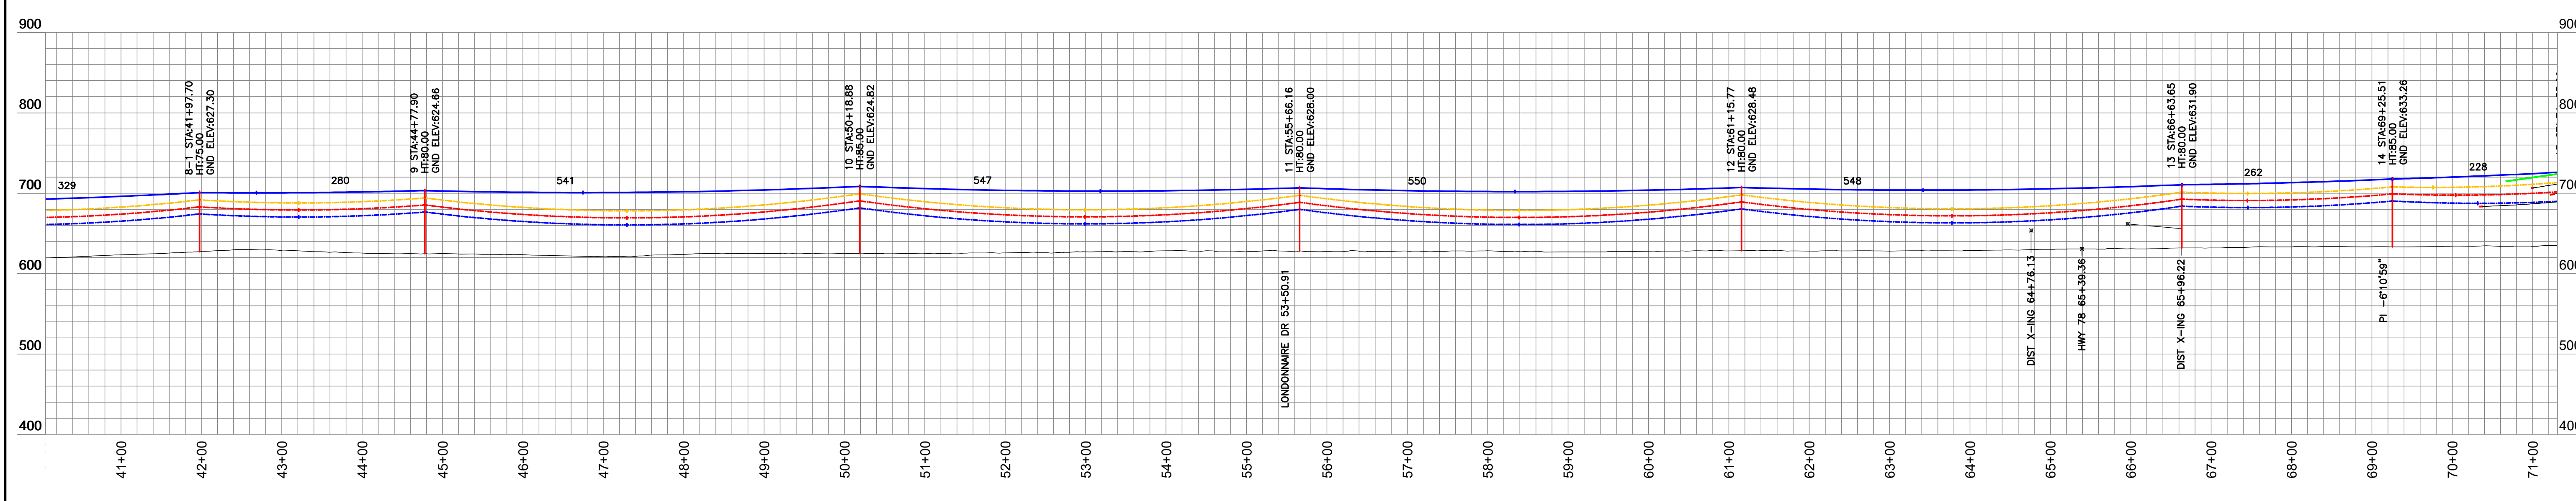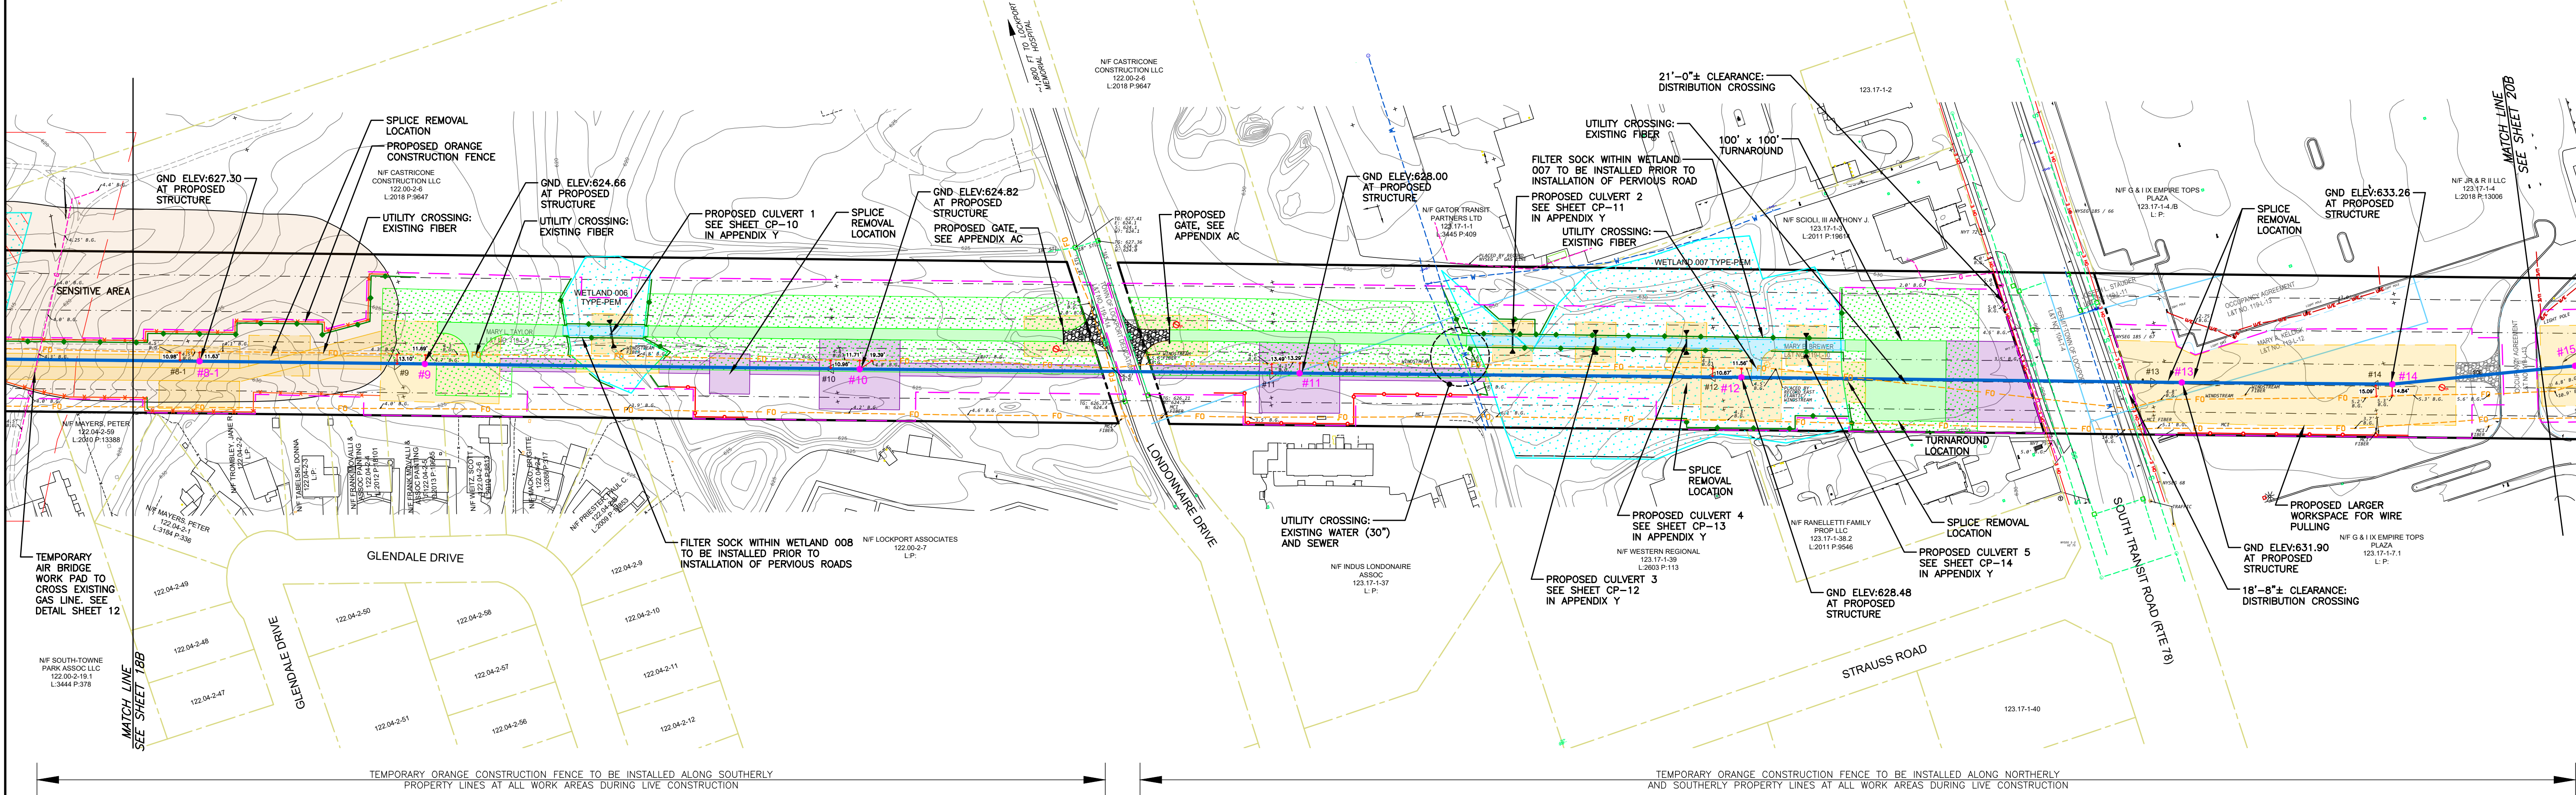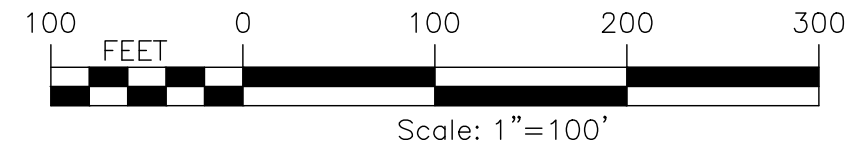

LOCKPORT - BATAVIA 112 LINE (FROM 1- 5 TO 211)																
EXISTING STR NUMBER	NEW STR NUMBER	TYPE	EXISTING STRUCTURE				TYPE	MATERIAL	POLE 1		POLE 2		POLE 3		FOUNDATION TYPE	NOTES
			HT (FT, AGL)	CL	HT (FT, AGL)	CL			HT (FT, AGL)	CL	HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL		
8-1	8-1	SC WD MONOPOLE DA SUSP	52	UNK				BPSU-DELTA	STEEL	95/20	H3				INSTALL DIRECT EMBED (1)	
9	9	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	100/20	H3				INSTALL DIRECT EMBED (1)	
10	10	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	105/20	H4				INSTALL DIRECT EMBED (1)	
11	11	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	100/20	H3				INSTALL DIRECT EMBED (1)	
12	12	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	100/20	H3				INSTALL DIRECT EMBED (1)	
13	13	SC STL TRI LEGGED TOWER DE	59					BPSU-DELTA	STEEL	100/20	H3				INSTALL DIRECT EMBED (1)	
14	14	SC STL TRI LEGGED TOWER SUSP	50					BPSU-DELTA	STEEL	105/20	H4				INSTALL DIRECT EMBED (1)	
15	15	DC STEEL LATTICE TOWER DE	66					SPDE	STEEL	90/0	N/A				INSTALL CONCRETE CAISSON (1)	

LOCKPORT - BATAVIA LINE 112			
OPGW 1/2"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
4	15	485.47	5000

LOCKPORT - BATAVIA LINE 112			
795 KCMIL ACSR "DRAKE"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
4	15	485.46	8000

CONDUCTOR DISPLAYED AT 257° F
SHIELDWIRE DISPLAYED AT 120° F

PREPARED FOR CONSTRUCTION GROUP USE

HOWEVER, THIS SHEET SHOULD NOT BE CONSIDERED THE SOLE SOURCE OF INFORMATION REQUIRED FOR THE CONSTRUCTION OF THAT PORTION OF THE PROJECT DEPICTED ON THIS SHEET AND SHOULD ONLY BE USED IN CONJUNCTION WITH SHEETS OF THE SAME NUMBER CONTAINED IN THIS SET OF PLANS.

6/06/25

6.1-L10-M5

L1-41568

19B

115KV TRANSMISSION LINES

LOCKPORT - BATAVIA 112

REBUILD PROJECT

CONSTRUCTION PLAN & PROFILE

nationalgrid

PREPARED BY

HP

APPROVED

FISHER

APPROVED

VL

APPROVED

RW

APPROVED

ACCOUNT NUMBER


DATE

DESCRIPTION OF ISSUE OR REVISION


DR.

CK.

APP.

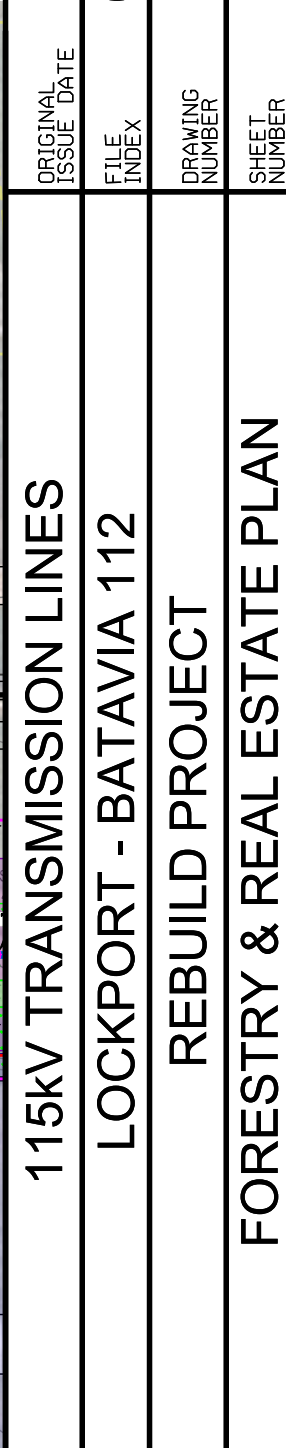

TEMPORARY ORANGE CONSTRUCTION FENCE TO BE INSTALLED ALONG NORTHERLY
AND SOUTHERLY PROPERTY LINES AT ALL WORK AREAS DURING LIVE CONSTRUCTION

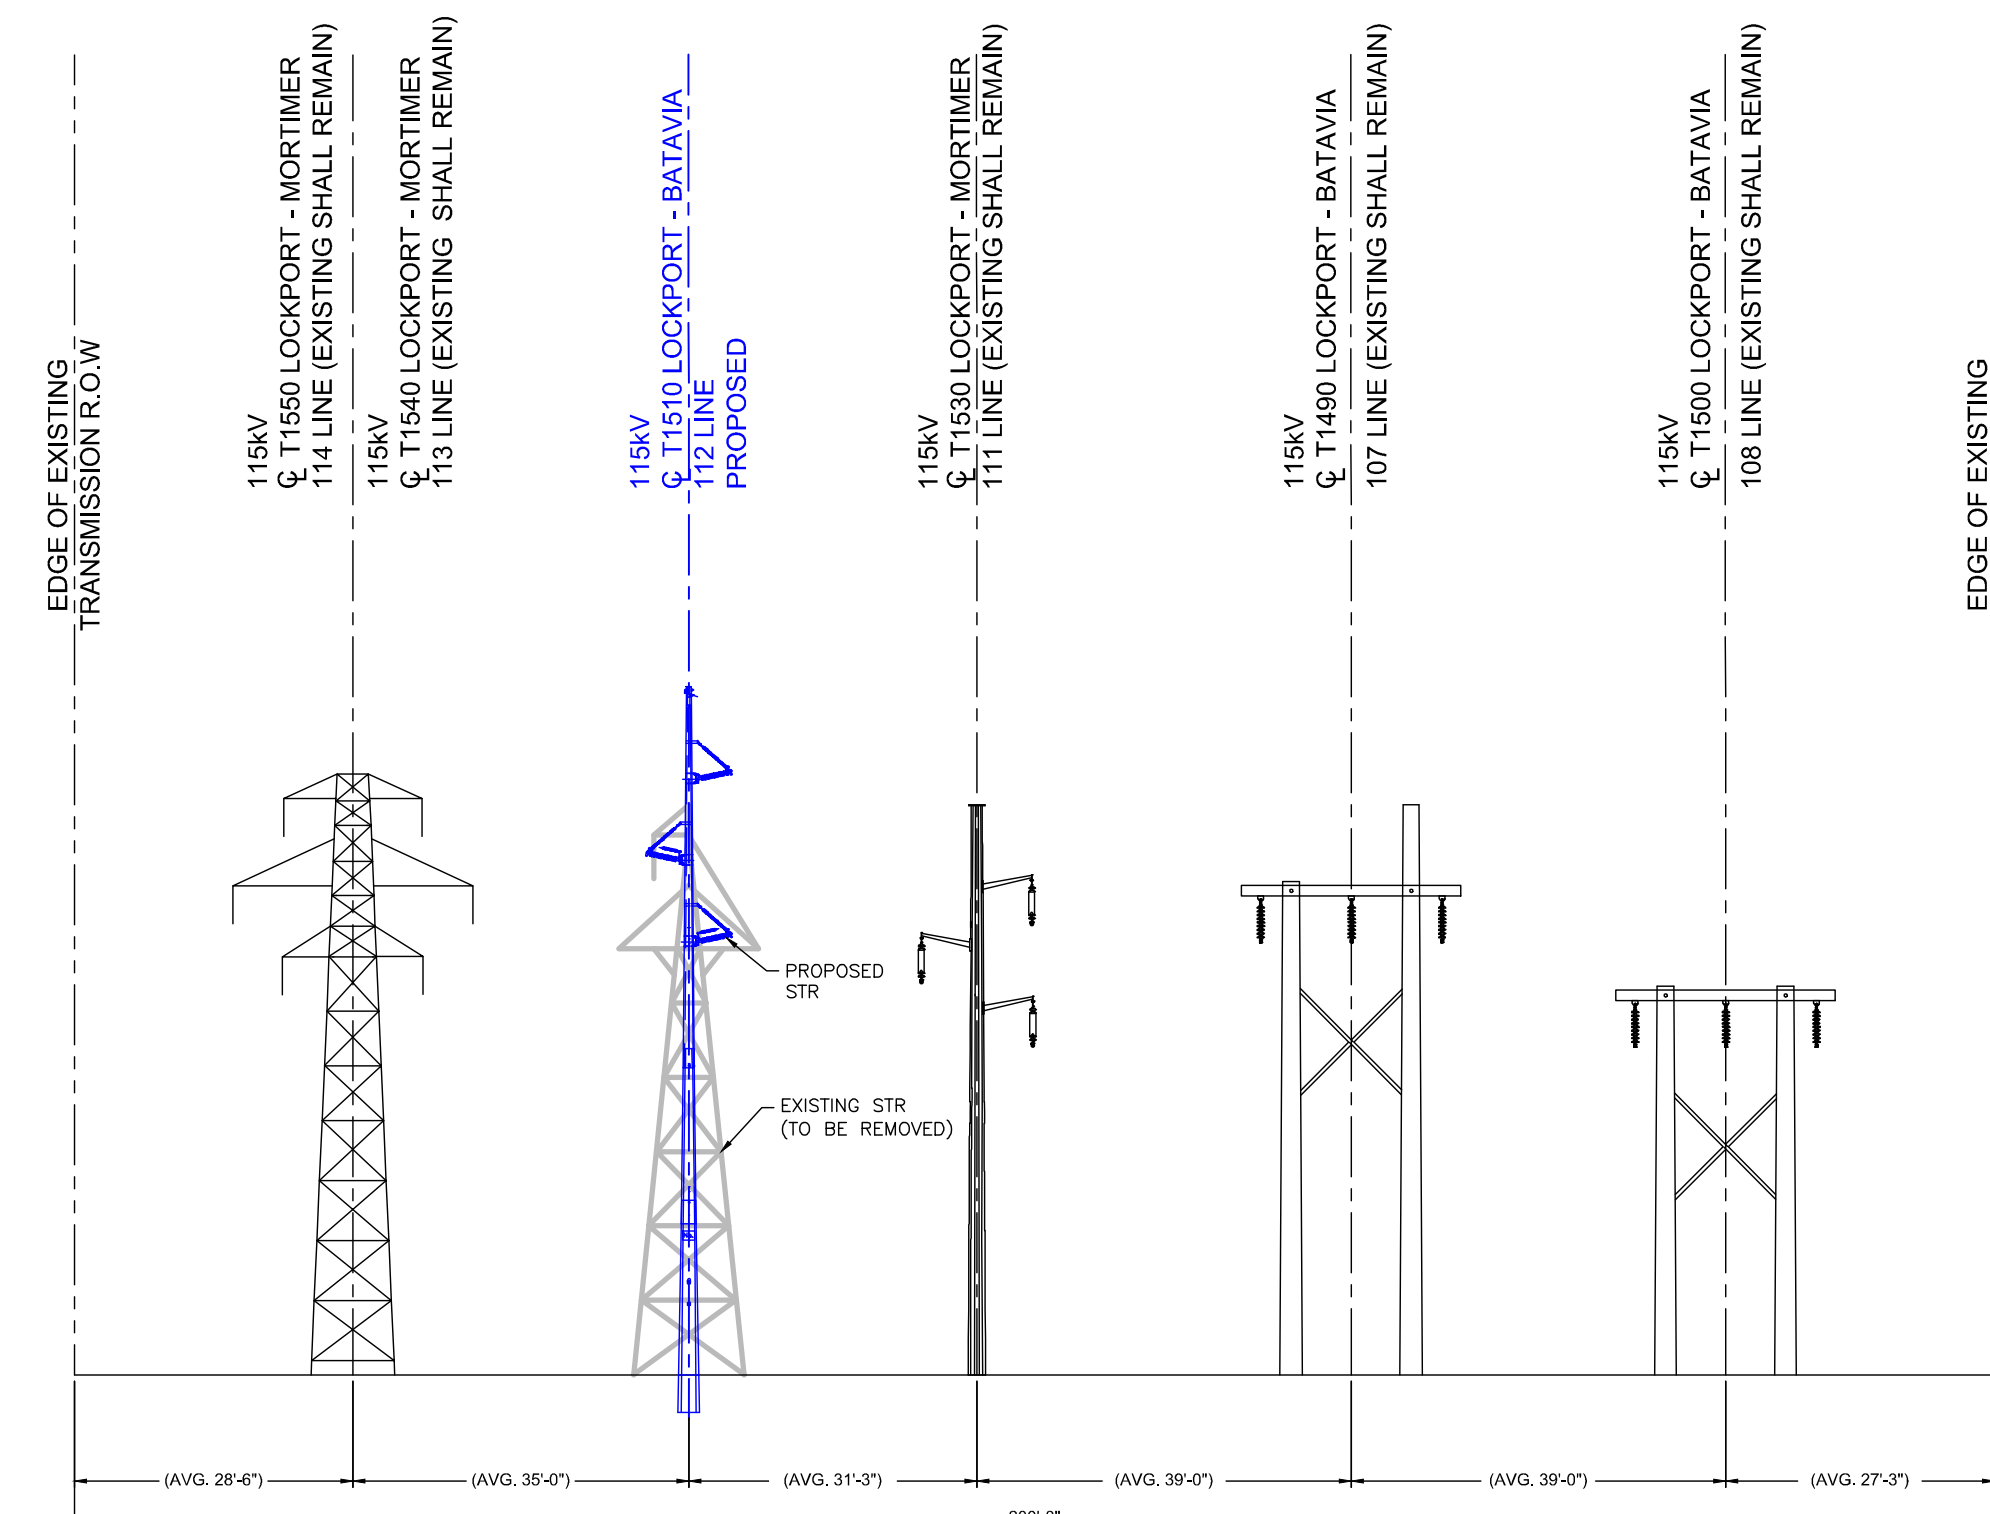

NIAGARA MOHAWK POWER CORP.
PROPOSED CROSS-SECTION CONFIGURATION
 FACING LOCKPORT SUBSTATION
 STRUCTURES 16 TO 35

- | | |
|---|---|
|  | WILDLIFE MANAGEMENT AREA |
|  | EROSION CONTROL FILTER STRIP |
|  | TYPE 2 - PERMANENT ACCESS ROADS & WORK AREAS |
|  | TYPE 3 - TIMBER MAT DURING CONSTRUCTION
PERVIOUS POST CONSTRUCTION |
|  | TYPE 4 - TEMPORARY CONSTRUCTION WORK AREAS,
PULLING PADS OR ACCESS, IMPROVE AS NECESSARY |
|  | TYPE 5 - TIMBER MAT ACCESS ROADS & WORK AREAS |
|  | TYPE 6 - BERM ACCESS, IMPROVE AS NECESSARY |

EXISTING #112 LINE STRUCTURES TO BE REMOVED.

SYMBOLS SHOWN HERE MAY BE LARGER THEN REPRESENTED ON DETAILED DRAWING

PREPARED BY

HP

ES:	APPROV
-----	--------

1100





1100

1100

--	--

[illegible]

TOWN OF LOCKPORT T.D. 5119 - NIAGARA COUNTY
PLAN VIEW

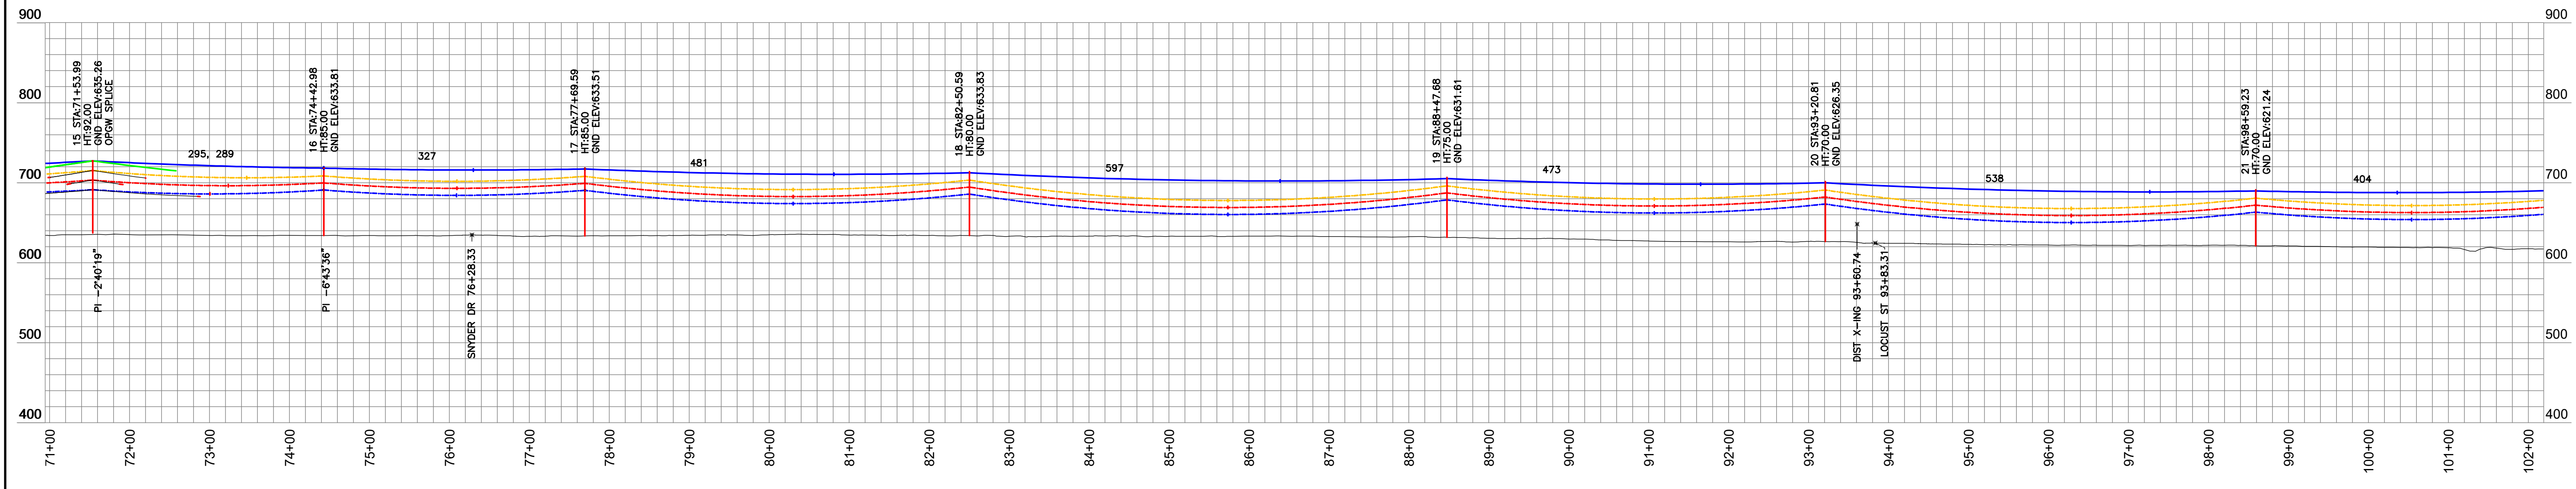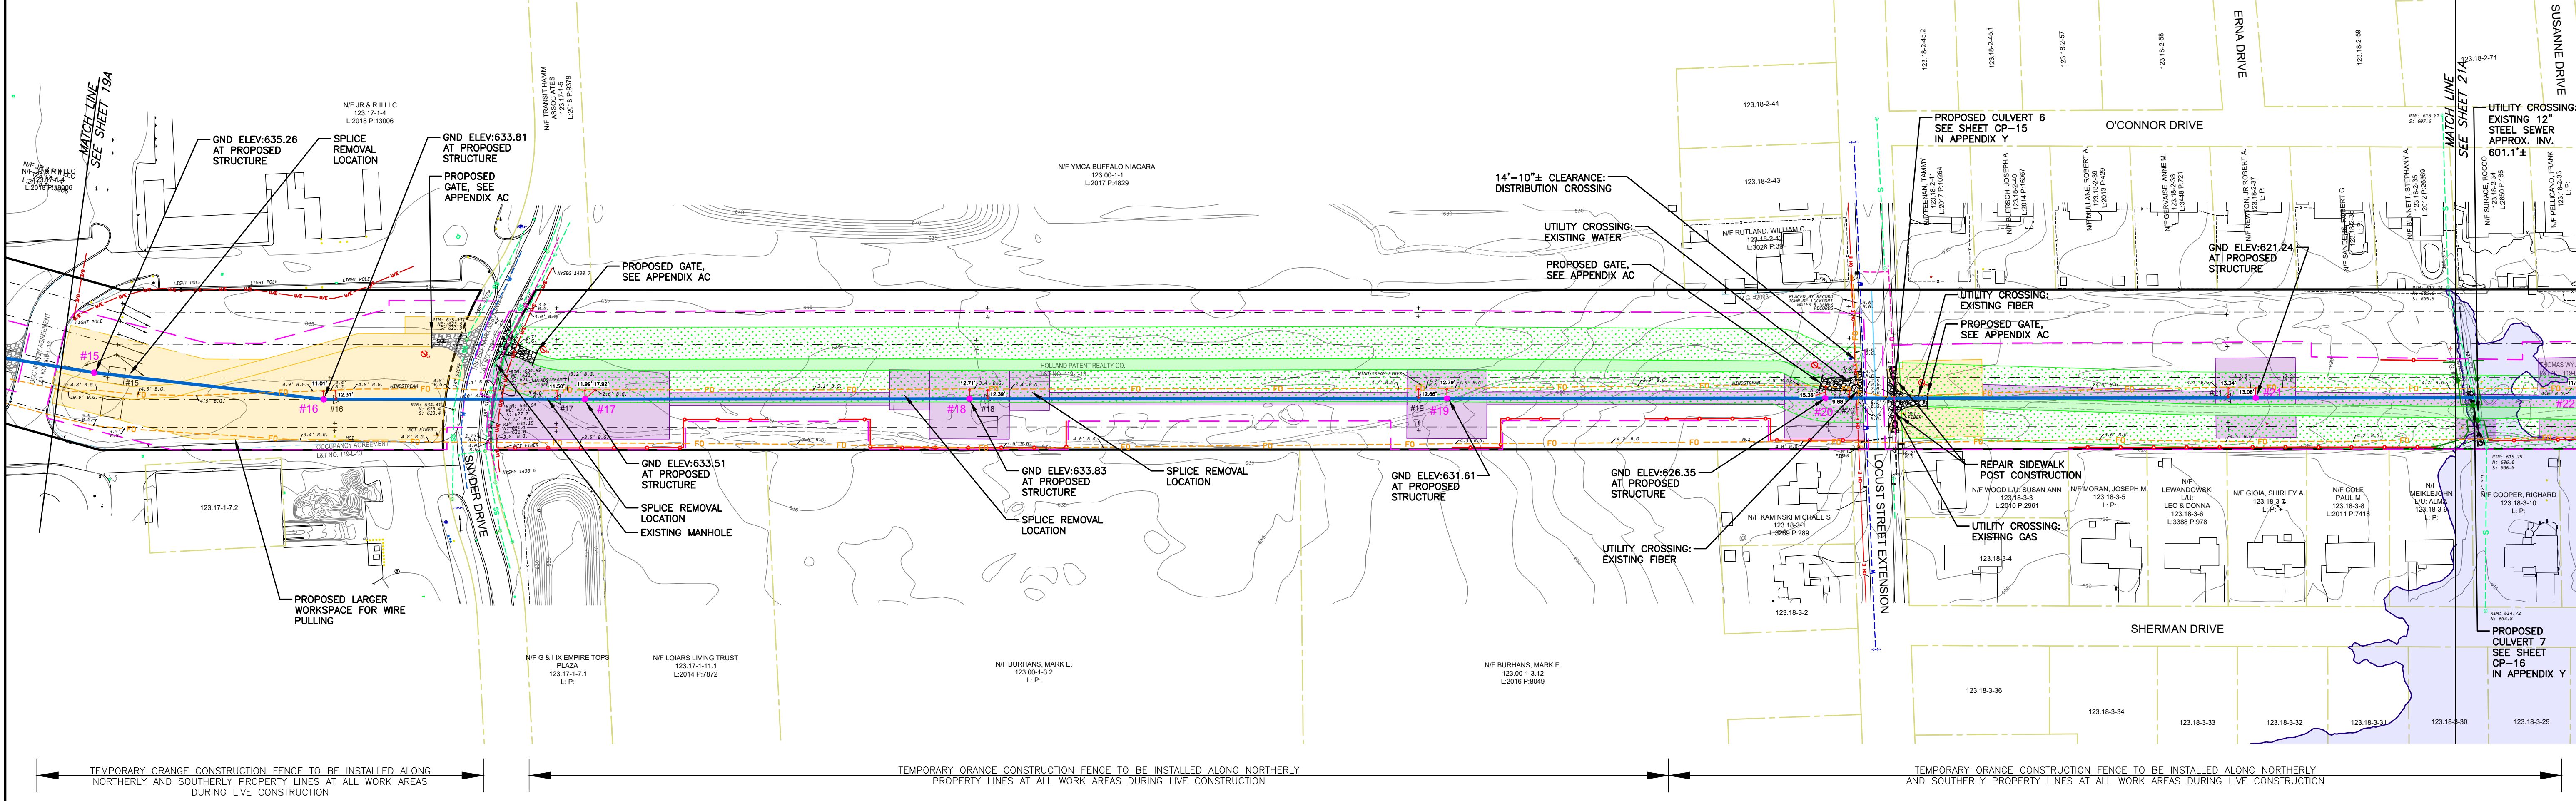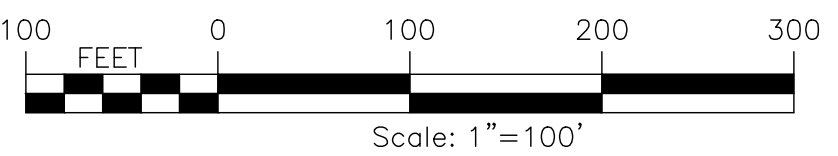

LOCKPORT - BATAVIA 112 LINE (FROM 1- 5 TO 211)																		
EXISTING STR NUMBER	NEW STR NUMBER	TYPE	EXISTING STRUCTURE						TYPE	POLE 1		POLE 2		POLE 3		FOUNDATION TYPE	NOTES	
			POLE 1		POLE 2		POLE 3			MATERIAL	HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)			CL
			HT (FT, AGL)	CL	HT (FT, AGL)	CL	HT (FT, AGL)	CL										
15	15	DC STEEL LATTICE TOWER DE	66					SPDE	STEEL	90/0	N/A					INSTALL CONCRETE CAISSON (1)		
16	16	SC STL TRI LEGGED TOWER SUSP	49					BPSU-DELTA	STEEL	105/20	H6					INSTALL DIRECT EMBED (1)		
17	17	SC STL TRI LEGGED TOWER DE	59					BPSU-DELTA	STEEL	105/20	H4					INSTALL DIRECT EMBED (1)		
18	18	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	100/20	H3					INSTALL DIRECT EMBED (1)		
19	19	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)		
20	20	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)		
21	21	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	90/20	H3					INSTALL DIRECT EMBED (1)		
22	22	SC STL TRI LEGGED TOWER SUSP	56					BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)		

LOCKPORT - BATAVIA LINE 112			
OPGW 1/2"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
15	36	521.23	5000

LOCKPORT - BATAVIA LINE 112			
795 KCMIL ACSR "DRAKE"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
15	36	521.23	8000

CONDUCTOR DISPLAYED AT 257° F
SHIELDWIRE DISPLAYED AT 120°F

PREPARED FOR CONSTRUCTION GROUP USE

HOWEVER, THIS SHEET SHOULD NOT BE CONSIDERED THE SOLE SOURCE OF INFORMATION REQUIRED FOR THE CONSTRUCTION OF THAT PORTION OF THE PROJECT DEPICTED ON THIS SHEET AND SHOULD ONLY BE USED IN CONJUNCTION WITH SHEETS OF THE SAME NUMBER CONTAINED IN THIS SET OF PLANS.

15KV TRANSMISSION LINES
LOCKPORT - BATAVIA 112
REBUILD PROJECT
CONSTRUCTION PLAN & PROFILE


6/06/25
6.1-L10-M5
L1-41568
20B

1
2
3
4
5
6


nationalgrid

PREPARED BY
HP
FISHER
VL
RW
BES.
PR.
CK.
APP.
DR.

DATE

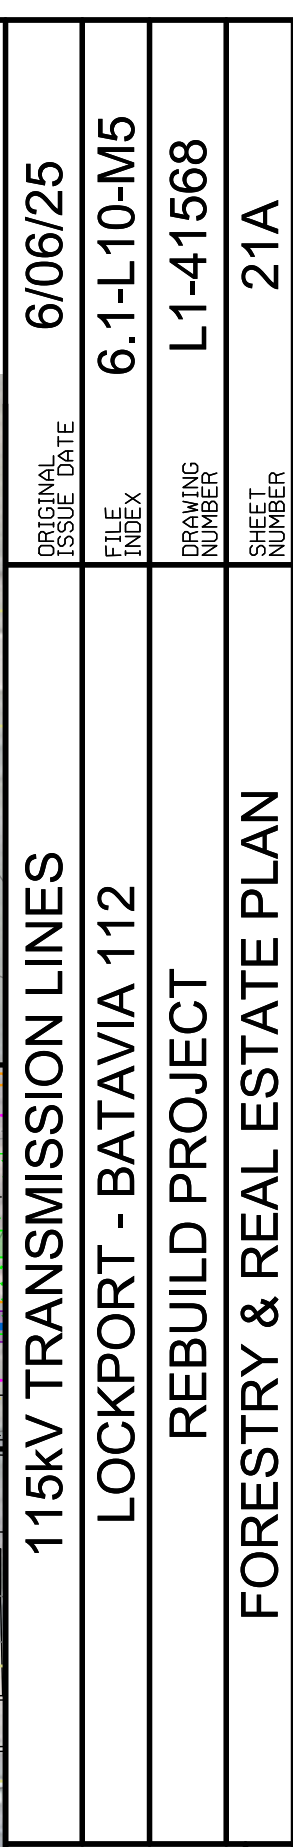

PREPARED BY **nationalgrid** ACCOUNT NUMBER

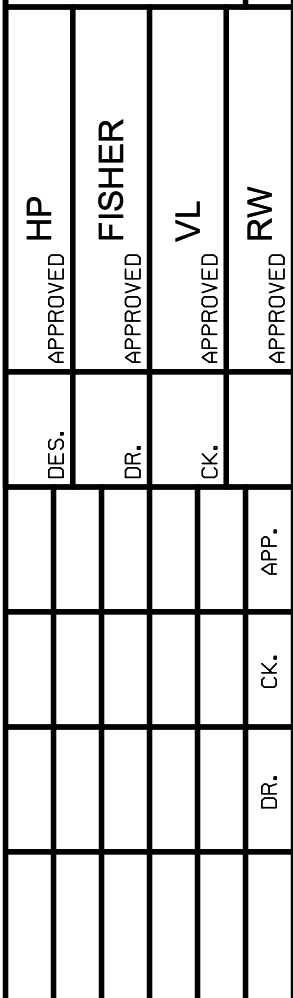
[illegible]

- WOOD POLES
FLEX TOWERS
SQUARE BASE TOWERS
3 LEGGED TOWERS
GUY WIRES
CULVERT
DITCH

STREAM CENTERLINE, I.D. NUMBER CLASS
STREAM BANK, I.D. NUMBER & CLASS
DEC WETLAND





DEC WET1 AND 100' ADJACENT AREA

- | | |
|--|--|
| | CONTOUR LINE (MAJOR) |
| | CONTOUR LINE (MINOR) |
| | PERMANENT STABILIZED CONSTRUCTION ENTRANCE |
| | TEMPORARY STABILIZED CONSTRUCTION ENTRANCE |
| | LIMIT OF DISTURBANCE |
| | FENCE |
| | PARK BOUNDARY LINE |
| | FEMA FLOODPLAIN |

- | | |
|---|--|
|  | WILDLIFE MANAGEMENT AREA |
|  | EROSION CONTROL FILTER STRIP |
|  | TYPE 2 - PERMANENT ACCESS ROADS & WORK AREAS |
|  | TYPE 3 - TIMBER MAT DURING CONSTRUCTION PERVIOUS POST CONSTRUCTION |
|  | TYPE 4 - TEMPORARY CONSTRUCTION WORK AREAS, PULLING PADS OR ACCESS, IMPROVE AS NECESSARY |
|  | TYPE 5 - TIMBER MAT ACCESS ROADS & WORK AREAS |
|  | TYPE 6 - BERM ACCESS, IMPROVE AS NECESSARY |

EXISTING #112 LINE STRUCTURES TO BE REMOVED.
SYMBOLS SHOWN HERE MAY BE LARGER THEN REPRESENTED ON DETAILED DRAWING

TOWN OF LOCKPORT T.D. 5119 - NIAGARA COUNTY
PLAN VIEW

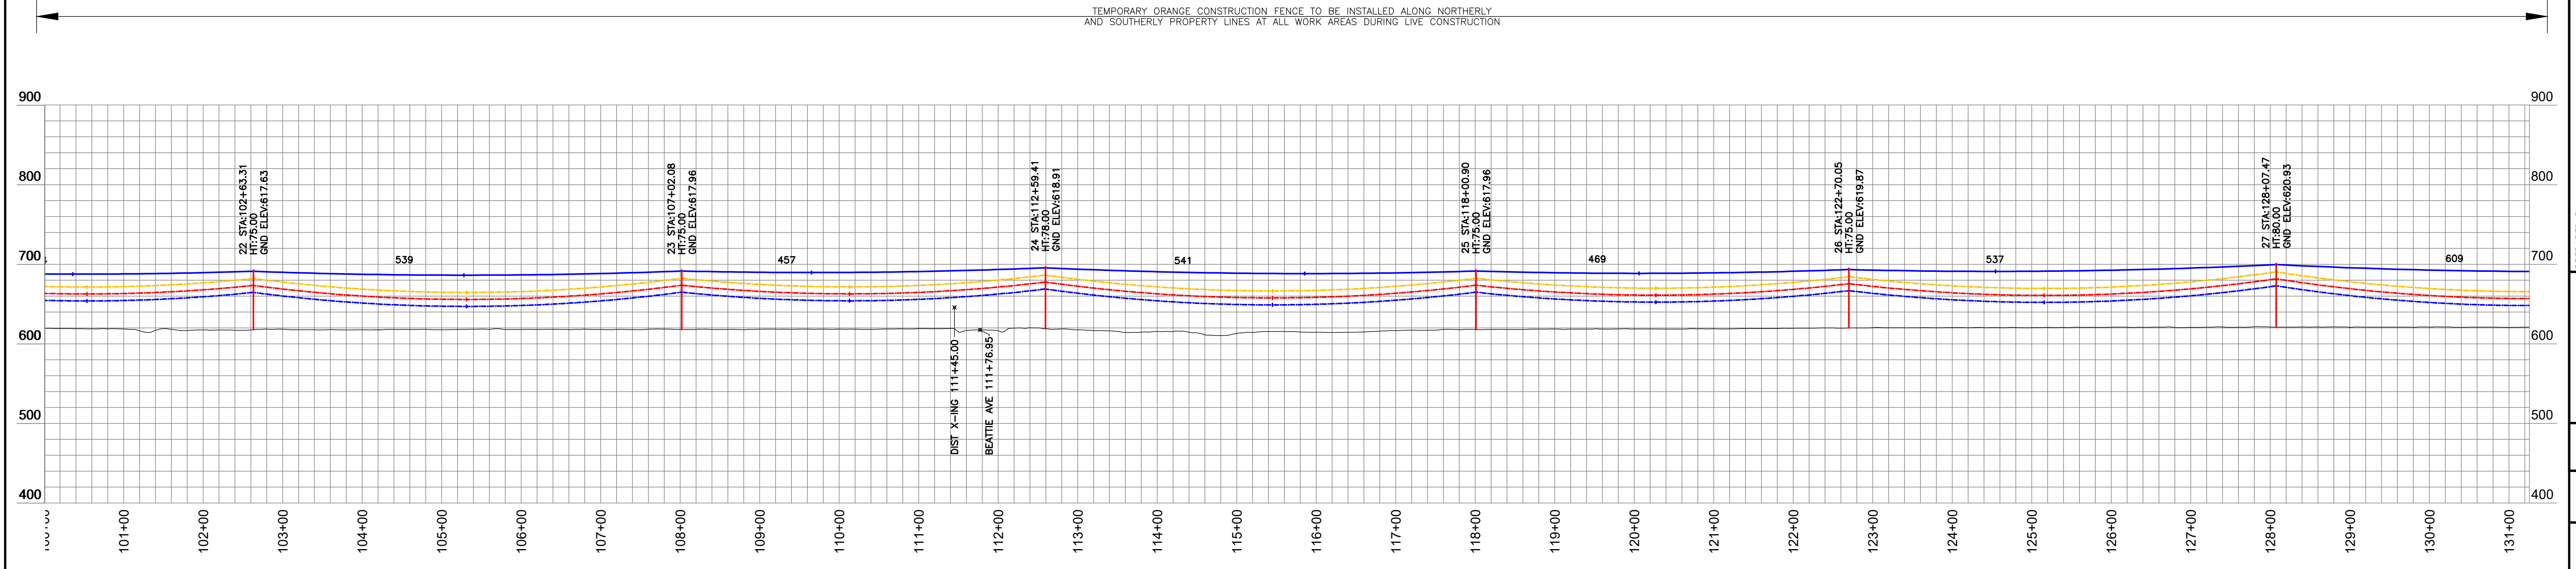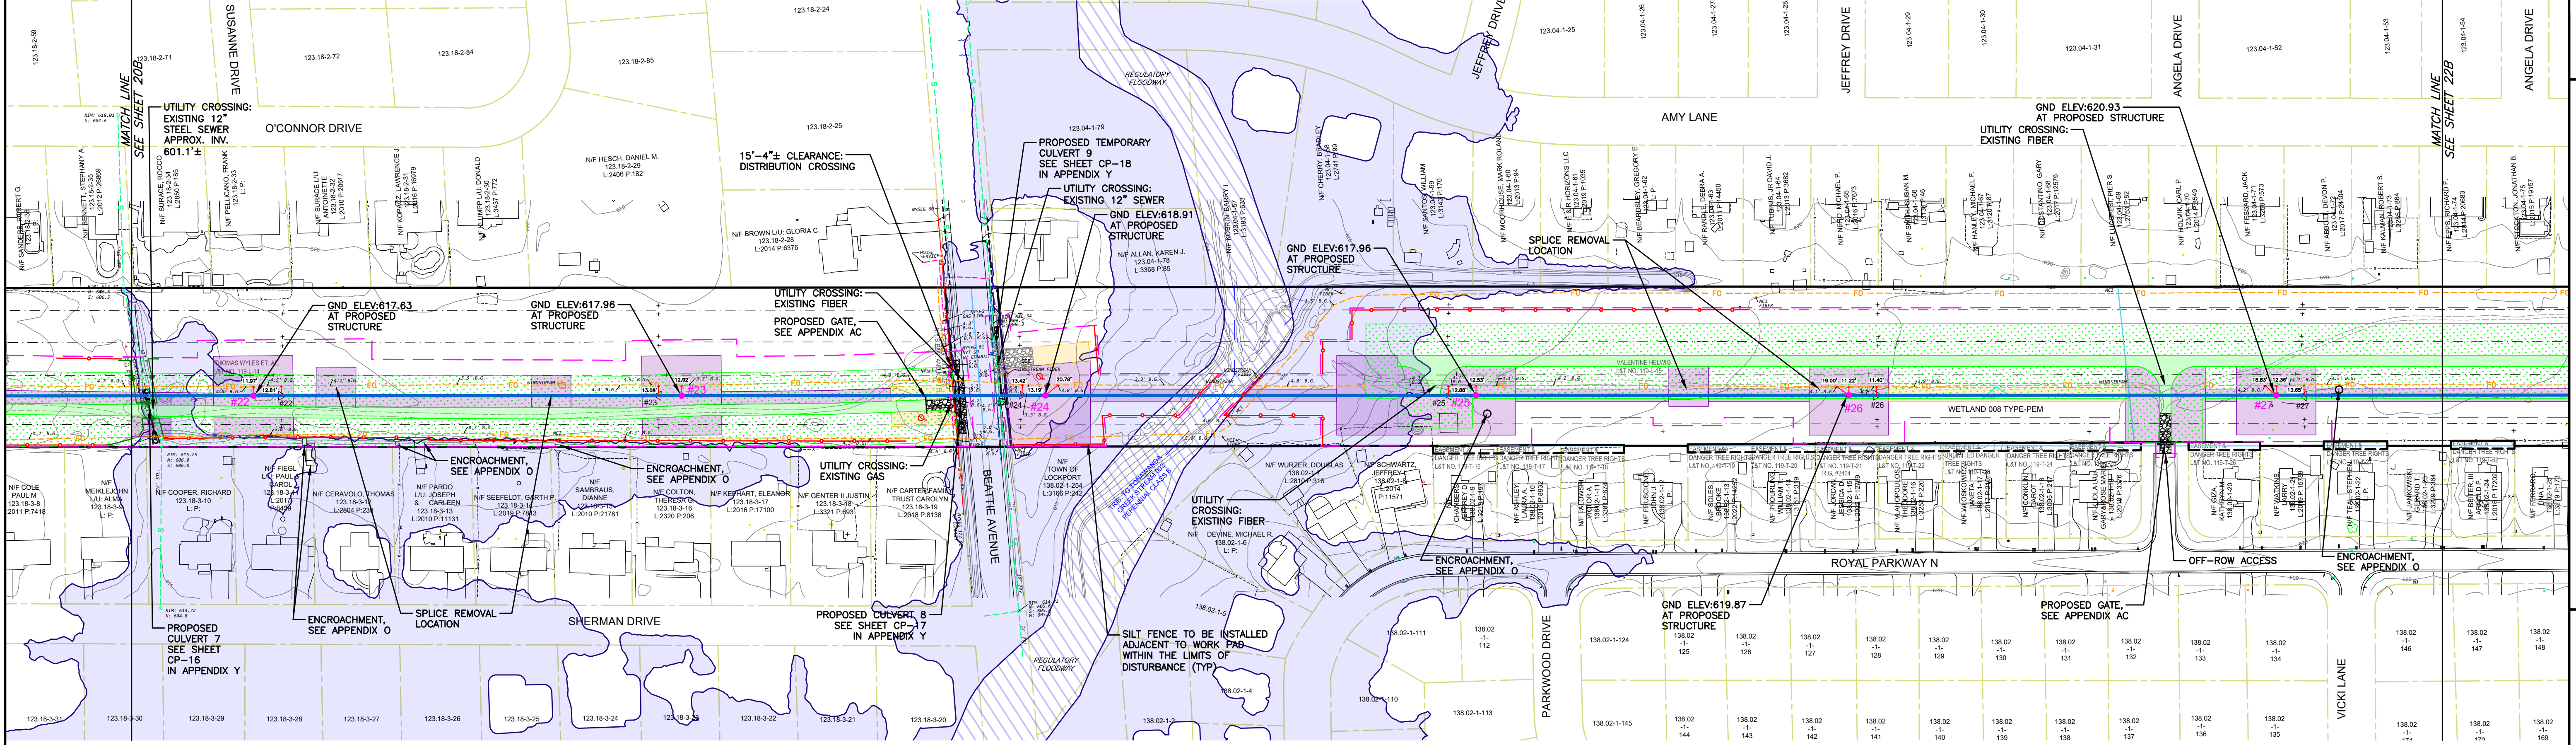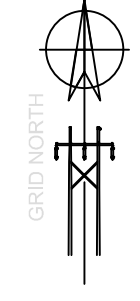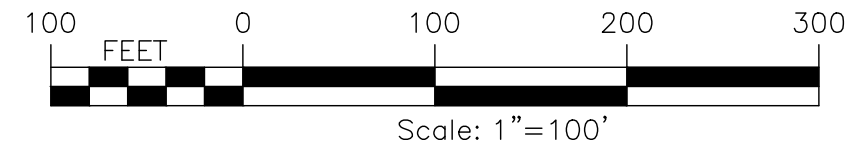

LOCKPORT - BATAVIA 112 LINE (FROM 1- 5 TO 211)																		
EXISTING STR NUMBER	NEW STR NUMBER	TYPE	EXISTING STRUCTURE						TYPE	POLE 1			POLE 2		POLE 3		FOUNDATION TYPE	NOTES
			POLE 1		POLE 2		POLE 3			MATERIAL	HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL		
			HT (FT, AGL)	CL	HT (FT, AGL)	CL	HT (FT, AGL)	CL										
22	22	SC STL TRI LEGGED TOWER SUSP	56						BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)	
23	23	SC STL TRI LEGGED TOWER SUSP	56						BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)	
24	24	SC STL TRI LEGGED TOWER SUSP	57						BPSU-DELTA	STEEL	100/22	H3					INSTALL DIRECT EMBED (1)	
25	25	SC STL TRI LEGGED TOWER SUSP	57						BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)	
26	26	SC STL TRI LEGGED TOWER SUSP	56						BPSU-DELTA	STEEL	95/20	H3					INSTALL DIRECT EMBED (1)	
27	27	SC STL TRI LEGGED TOWER SUSP	57						BPSU-DELTA	STEEL	100/20	H3					INSTALL DIRECT EMBED (1)	

LOCKPORT - BATAVIA LINE 112			
OPGW 1/2"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
15	36	521.23	5000

LOCKPORT - BATAVIA LINE 112			
795 KCMIL ACSR "DRAKE"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
15	36	521.23	8000

CONDUCTOR DISPLAYED AT 257° F
SHIELDWIRE DISPLAYED AT 120°F

PREPARED FOR CONSTRUCTION GROUP USE

HOWEVER, THIS SHEET SHOULD NOT BE CONSIDERED THE SOLE SOURCE OF INFORMATION REQUIRED FOR THE CONSTRUCTION OF THAT PORTION OF THE PROJECT DEPICTED ON THIS SHEET AND SHOULD ONLY BE USED IN CONJUNCTION WITH SHEETS OF THE SAME NUMBER CONTAINED IN THIS SET OF PLANS.

15KV TRANSMISSION LINES
LOCKPORT - BATAVIA 112
REBUILD PROJECT
CONSTRUCTION PLAN & PROFILE

6/06/25
6.1-L10-M5
L1-41508
21B

1
2
3
4
5
6

nationalgrid




PREPARED BY
HP
FISHER
VL
RW
APPROVED
BES
PR
CK
APP
DR

ACCOUNT NUMBER


DATE

DESCRIPTION OF ISSUE OR REVISION

TOWN OF LOCKPORT T.D. 5119 - NIAGARA COUNTY
PLAN VIEW

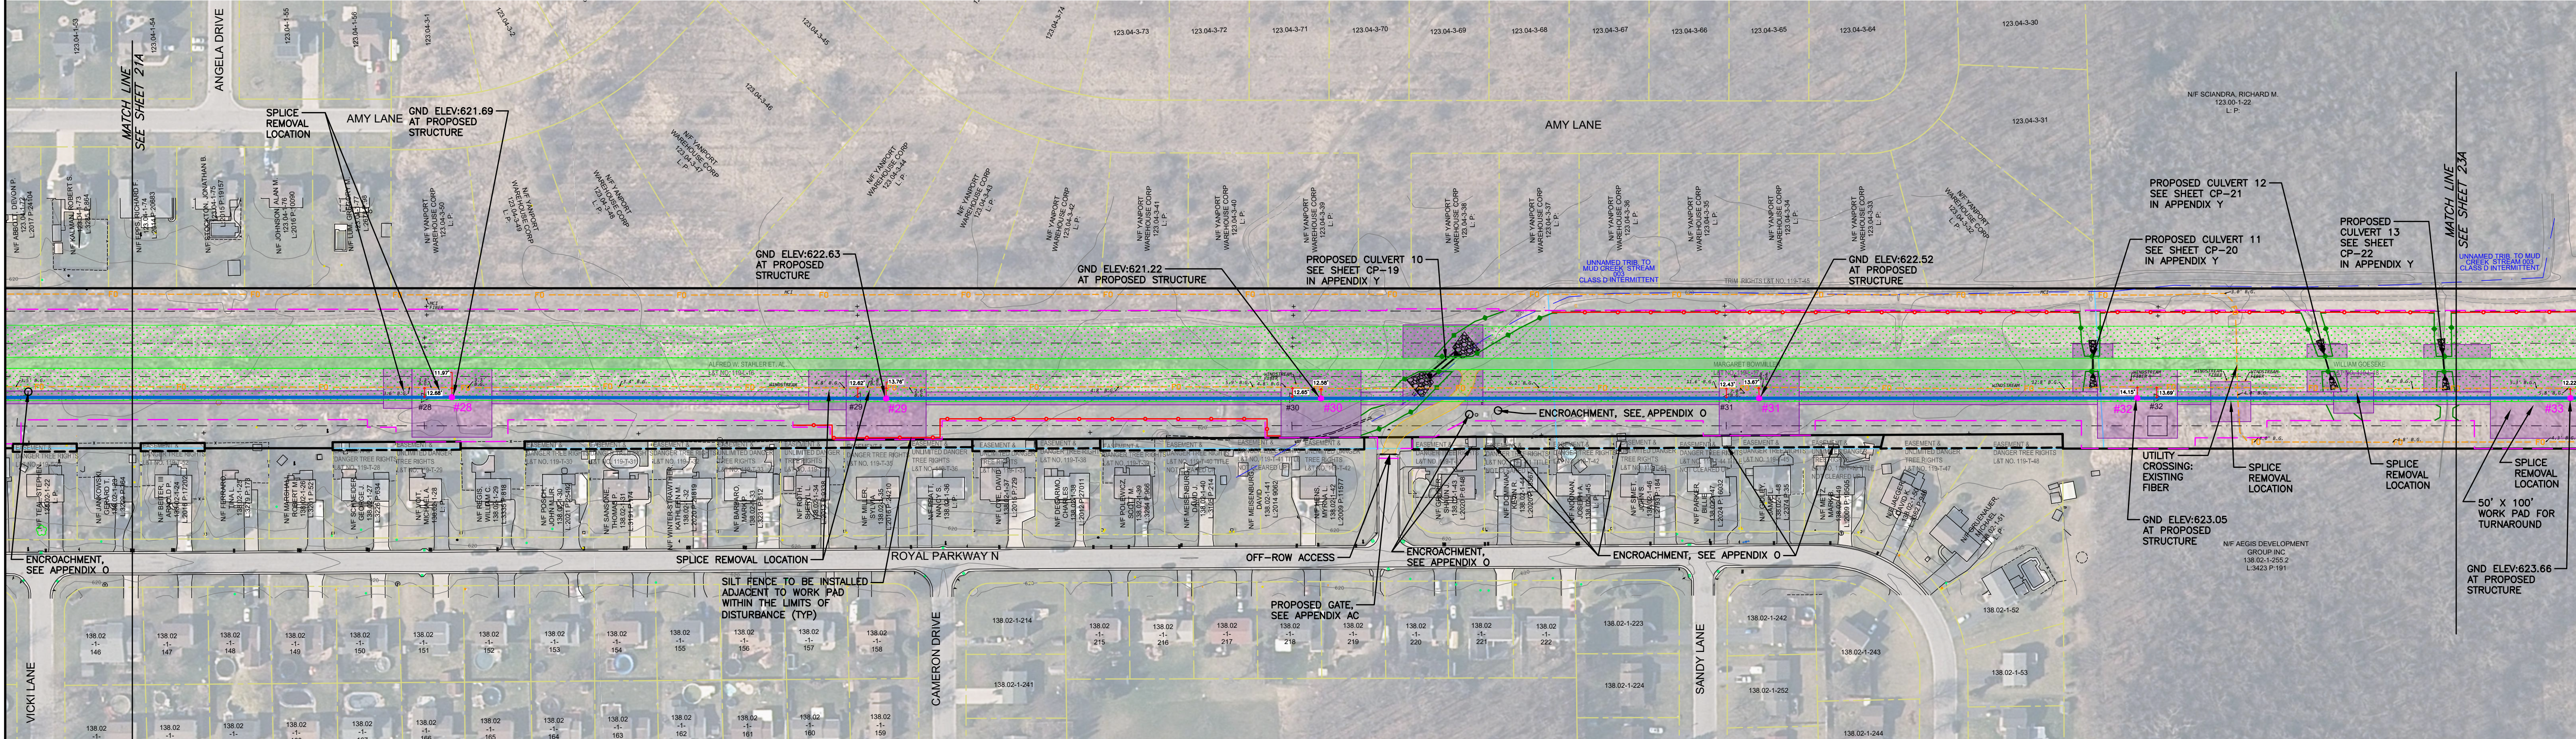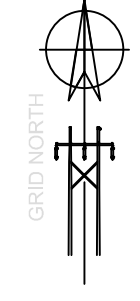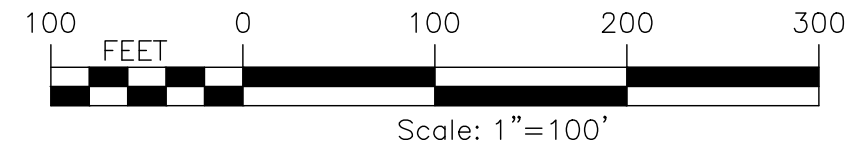

TEMPORARY ORANGE CONSTRUCTION FENCE TO BE INSTALLED ALONG NORTHERLY AND SOUTHERLY PROPERTY LINES AT ALL WORK AREAS DURING LIVE CONSTRUCTION




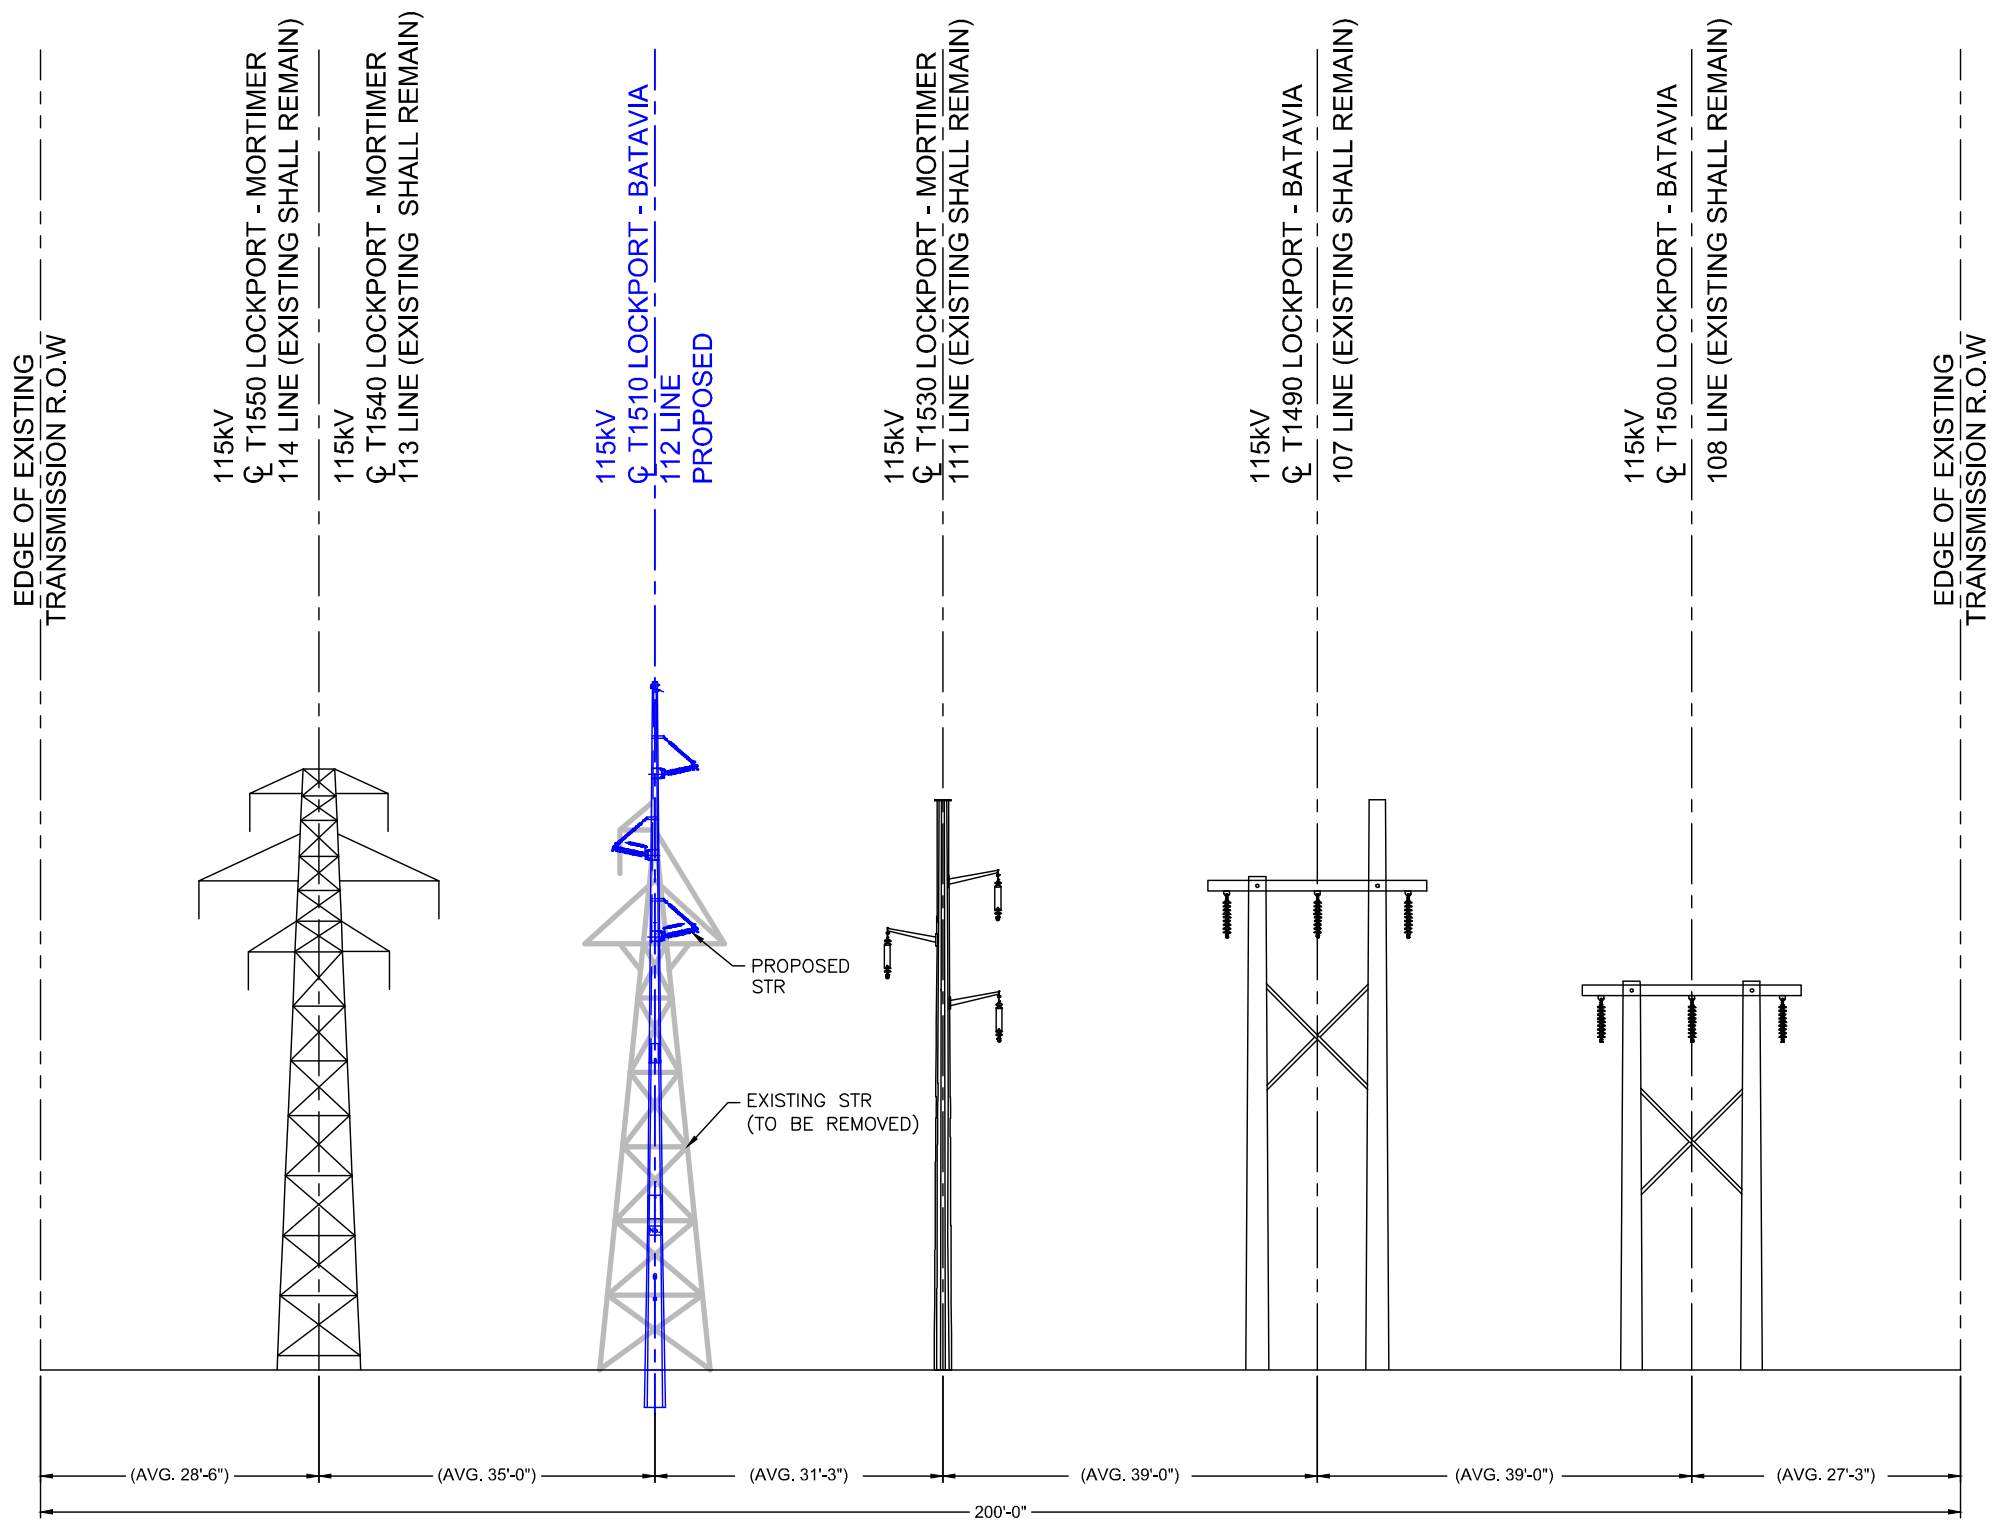


NIAGARA MOHAWK POWER CORP.
PROPOSED CROSS-SECTION CONFIGURATION
FACING LOCKPORT SUBSTATION
STRUCTURES 16 TO 35

EXISTING FEATURES		PROPOSED FEATURES		PROPOSED PERMANENT EASEMENT		WILDLIFE MANAGEMENT AREA	
PROPERTY COUNTY TAX MAP	UNDERGROUND SANITARY SEWER	WOOD POLES	DELINEATED WETLANDS	300' CONTOUR LINE (MAJOR)	TRANSMISSION LINES (115KV)	WILDLIFE MANAGEMENT AREA	
CONTOUR LINE	UNDERGROUND TELEPHONE	FLEX TOWERS	WATER BODY	300' CONTOUR LINE (MINOR)	PROPOSED STRUCTURE LOCATION	EROSION CONTROL FILTER STRIP	
TOWN LINE	NIAGARA MOHAWK POWER CORP. EXISTING PROPERTY LINES	SQUARE BASE TOWERS		PERMANENT STABILIZED CONSTRUCTION ENTRANCE	PROPOSED INVASIVE SPECIES CLEANING STATION	TYPE 2 - PERMANENT ACCESS ROADS & WORK AREAS	
FENCE	NIAGARA MOHAWK POWER CORP. EXISTING EASEMENT LIMITS	3 LEGGED TOWERS	PROPOSED FEATURES	TEMPORARY STABILIZED CONSTRUCTION ENTRANCE	GATE TO BE INSTALLED	TYPE 3 - TIMBER MAT DURING CONSTRUCTION PREVIOUS POST CONSTRUCTION	
OVERHEAD ELECTRIC	NIAGARA MOHAWK POWER CORP. LEGACY PROPERTY LINES	GUY WIRES	SILT FENCE	LIMIT OF DISTURBANCE	TYPE 1 - PROPOSED ACCESS OVER EXISTING, IMPROVE AS NECESSARY	TYPE 4 - TEMPORARY CONSTRUCTION WORK AREAS, PULLING PADS OR ACCESS, IMPROVE AS NECESSARY	
UNDERGROUND ELECTRIC	ADJOINER PROPERTY LINES	CULVERT	FILTER SOCK	FENCE	EXISTING #112 LINE STRUCTURES TO BE REMOVED.	TYPE 5 - TIMBER MAT ACCESS ROADS & WORK AREAS	
UNDER GROUND GAS LINE	NIAGARA MOHAWK POWER CORP. TAX MAP IDENTIFICATION NUMBER (S.B.L)	BOX CULVERT	CULVERT	PARK BOUNDARY LINE	SYMBOLS SHOWN HERE MAY BE LARGER THEN REPRESENTED ON DETAILED DRAWING.	TYPE 6 - BERM ACCESS, IMPROVE AS NECESSARY	
UNDER GROUND FIBER OPTIC	SUB-TRANSMISSION & TRANSMISSION LINES	ROCK OUTLET PROTECTION	BOX CULVERT	FEMA FLOODPLAIN			
UNDER GROUND WATER		DITCH	DITCH				
UNDER GROUND PETROLEUM		STREAM CENTERLINE, I.D. NUMBER CLASS					
UNDERGROUND STORM SEWER		STREAM BANK, I.D. NUMBER & CLASS					
		DEC WETLAND 100' ADJACENT AREA					

1	6/06/25	115KV TRANSMISSION LINES	LOCKPORT - BATAVIA 112	REBUILD PROJECT	FORESTRY & REAL ESTATE PLAN	22A	1
2	6.1-L10-M5						2
3	L1-41508						3
4							4
5							5
6							6

TOWN OF LOCKPORT T.D. 5119 - NIAGARA COUNTY
PLAN VIEW

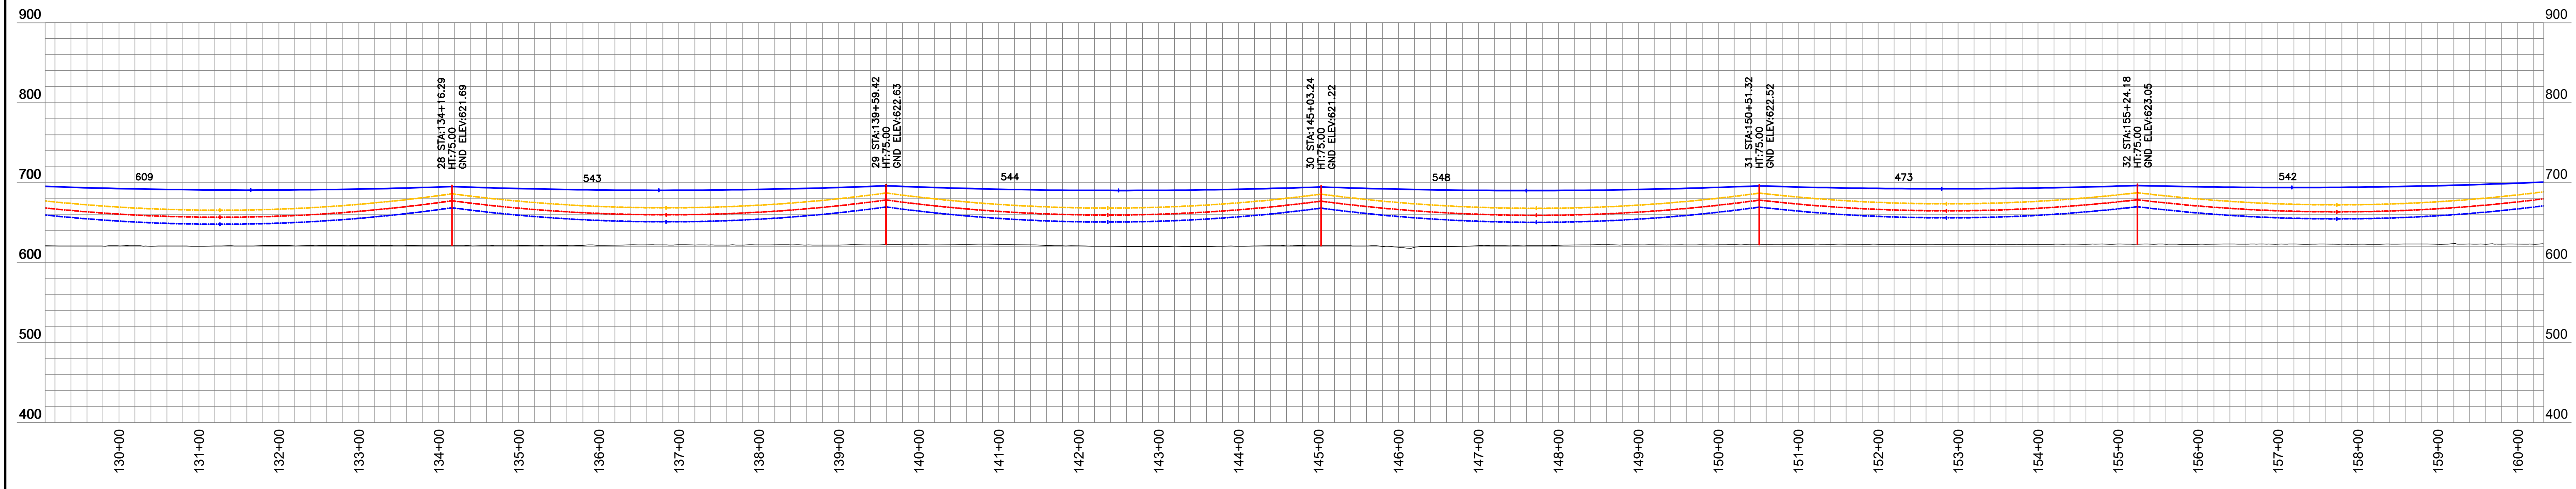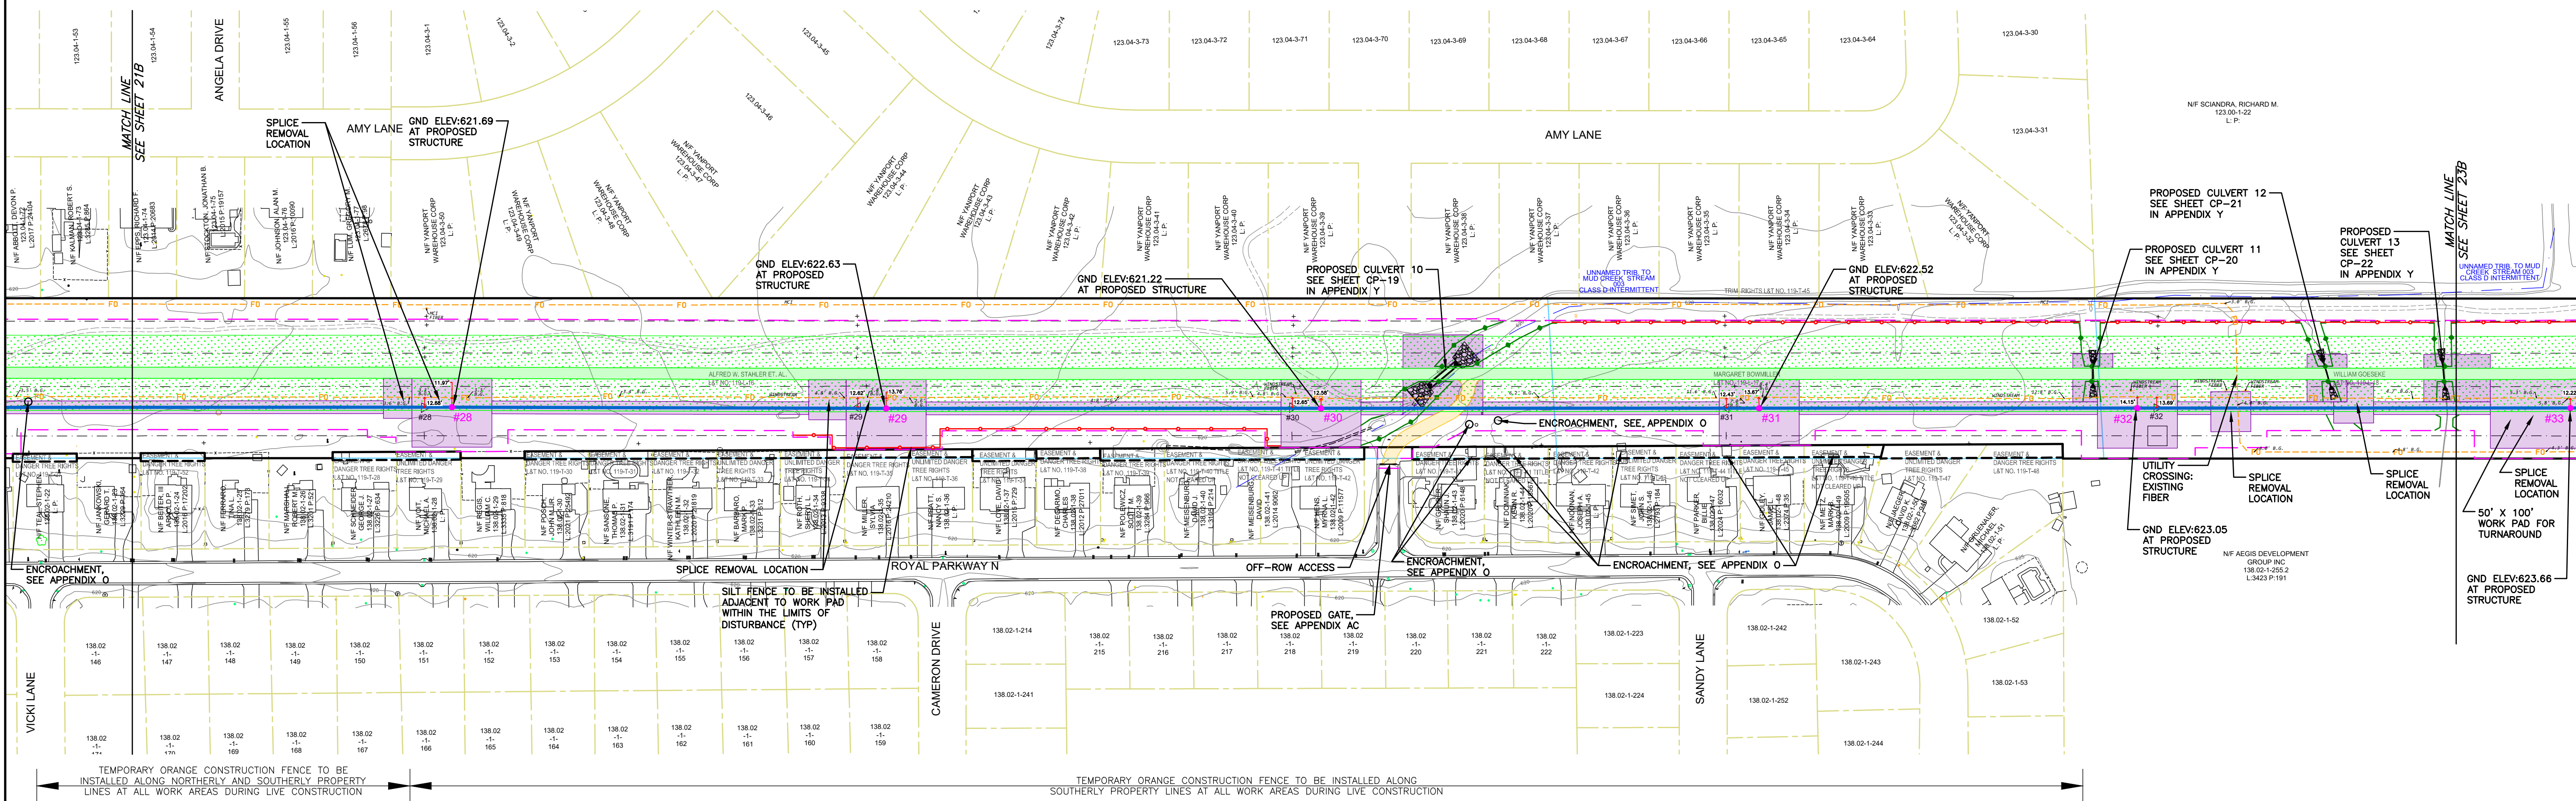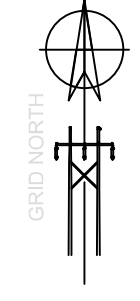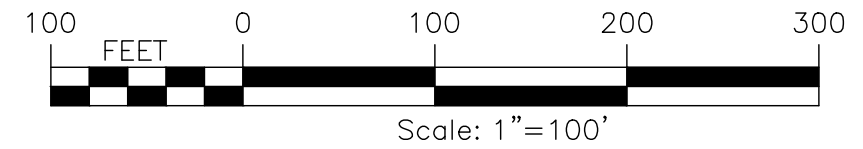

LOCKPORT - BATAVIA 112 LINE (FROM 1- 5 TO 211)																		
EXISTING STR NUMBER	NEW STR NUMBER	TYPE	EXISTING STRUCTURE						TYPE	MATERIAL	POLE 1		POLE 2		POLE 3		FOUNDATION TYPE	NOTES
			HT (FT, AGL)	CL	HT (FT, AGL)	CL	HT (FT, AGL)	CL			HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL	HT, FT (TOTAL/ EMB)	CL		
27	27	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	100/20	H3						INSTALL DIRECT EMBED (1)	
28	28	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	95/20	H3						INSTALL DIRECT EMBED (1)	
29	29	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	95/20	H3						INSTALL DIRECT EMBED (1)	
30	30	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	95/20	H3						INSTALL DIRECT EMBED (1)	
31	31	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	95/20	H3						INSTALL DIRECT EMBED (1)	
32	32	SC STL TRI LEGGED TOWER DE	59					BPSU-DELTA	STEEL	95/20	H3						INSTALL DIRECT EMBED (1)	
33	33	SC STL TRI LEGGED TOWER SUSP	57					BPSU-DELTA	STEEL	100/20	H3						INSTALL DIRECT EMBED (1)	

LOCKPORT - BATAVIA LINE 112			
OPGW 1/2"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
15	36	521.23	5000

LOCKPORT - BATAVIA LINE 112			
795 KCMIL ACSR "DRAKE"			
FROM	TO	RULING SPAN	NESC HEAVY TENSION (LBS)
15	36	521.23	8000

CONDUCTOR DISPLAYED AT 257° F
SHIELDWIRE DISPLAYED AT 120° F

PREPARED FOR CONSTRUCTION GROUP USE

HOWEVER, THIS SHEET SHOULD NOT BE CONSIDERED THE SOLE SOURCE OF INFORMATION REQUIRED FOR THE CONSTRUCTION OF THAT PORTION OF THE PROJECT DEPICTED ON THIS SHEET AND SHOULD ONLY BE USED IN CONJUNCTION WITH SHEETS OF THE SAME NUMBER CONTAINED IN THIS SET OF PLANS.

6/06/25
6.1-L10-M5
L1-41508
22B

155KV TRANSMISSION LINES
LOCKPORT - BATAVIA 112
REBUILD PROJECT
CONSTRUCTION PLAN & PROFILE

nationalgrid

PREPARED BY
HP
FISHER
VL
RW

APPROVED
BES
PR
CK
APP.
DR.

ACCOUNT NUMBER

DATE

1
2
3
4
5
6